

October 3, 2023

Mr. Henry Ilges
Jennings School District
2559 Dorwood Drive
Jennings, MO 64136

RE: Drinking Water Sampling – Northview Elementary School
8920 Cozens Avenue
Jennings, MO 63136
Project Number: 923235

Mr. Ilges,

OCCU-TEC, Inc. (OCCU-TEC) is pleased to present the following report for drinking water sampling completed at Northview Elementary School in Jennings, Missouri. The sampling was requested and approved by Mr. Henry Ilges of Jennings School District (JSD). OCCU-TEC completed drinking water sampling of all potential drinking water sources, sources used in food preparation, cleaning, and utensil cleaning. Drinking water sampling was completed in accordance with the requirements set forth in Missouri Senate Bill #681/662 known as the “Get the Lead Out of School Drinking Water Act”.

METHODOLOGY

On August 11, 2023, Mr. Jeff Smith and Mr. Nathaniel Jones of OCCU-TEC completed testing of fifty-five (55) sources throughout Northview Elementary School. Samples were collected as ‘First Draw’ samples after the fixtures had remained unused for a minimum period of 8 hours. Samples were collected in dedicated, laboratory-provided 250-milliliter plastic sample containers. Sample location information and photographic documentation are noted in the attached table.

Samples were shipped to Teklab, Inc. (Teklab) of Collinsville, Illinois for analysis using EPA method 200.8. Teklab is approved for sample analysis by the Missouri Department of Natural Resources (MDNR) under certification number 00930. A copy of the laboratory analytical results and Chain of Custody documentation are attached to this report.

RESULTS

Samples results were compared to the regulatory limit of 5 parts per billion (ppb) outlined in Missouri Senate Bill 681/662. Of the samples collected, eighteen (18) of the fifty-five (55) contained lead concentrations at or above 5 ppb. Below is a list of samples containing elevated concentrations of lead.

Sample ID	Location	Type	Result (ug/L)
235-NVE-03	CL-209	Classroom Sink	15.9
235-NVE-05	CL-208	Classroom Sink	8.1
235-NVE-07	CL-207	Classroom Sink	9.4
235-NVE-10	CL-204	Classroom Sink	10.4
235-NVE-16	236 Girls' Restroom	Sink Basin, Right Fixture	9.7
235-NVE-17	CL-203	Classroom Sink	15.1
235-NVE-24	232 Girls' Restroom	Sink Basin, Right Fixture	5.7
235-NVE-27	CL-217	Classroom Sink	9.8
235-NVE-37	Kitchen	Hand Washing Sink	15.0
235-NVE-41	Kitchen	Handwashing Sink	44.9
235-NVE-47	CL-105	Classroom Sink	21.1
235-NVE-57	CL-108	Classroom Sink	6.4
235-NVE-61	CL-110	Classroom Sink	15.3
235-NVE-63	CL-112	Classroom Sink	17.0
235-NVE-65	CL-113	Classroom Sink	52.7
235-NVE-66	CL-113	Drinking Fountain	7.0
235-NVE-67	116 Counselor	Office Sink	11.8
235-NVE-68	CL-115	Classroom Sink	13.9

LIMITATIONS

At the request of JSD, janitorial closet sinks were excluded from sampling. OCCU-TEC recommends placing signage on all sources not sampled during this assessment that indicate the source is not to be used for drinking water.

RECOMMENDATIONS

The following recommendations are in accordance with Senate Bill 681/662.

In accordance with the requirements set forth in Missouri Bill 681/662, fixtures exhibiting lead concentrations above 5 ppb must be remediated by replacement of lead-containing pipes, solder, fittings or fixtures with lead-free components, or the school shall install filtration at each point where water enters the building until such time as the source can be remediated. If installing a filter is not feasible, the school shall provide purified water at each outlet inventoried.

Additionally, any water coolers or drinking water outlets identified by the United States Environmental Protection Agency (EPA) as not being lead-free under the federal Lead Contamination Control Act of 1988 shall be replaced unless the unit has been tested and determined to have lead results under 5 ppb.

Within two weeks after receiving test results, the school shall make all testing results and any lead remediation plans available on the school's website. The school shall notify parents and staff via written notification within seven (7) business days after receiving test results exceeding 5 ppb. The notification shall include the following:


- Test results and a summary explaining the results.
- A description of any remedial steps taken.
- A description of the general health effects of lead contamination and community specific resources.
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.

For fixtures exhibiting results above 5 ppb, follow up random "Flush" sampling shall be conducted annually on at least 25-percent of the remediated outlets until all outlets have been remediated. Drinking water sampling shall be conducted annually and annual drinking water test results shall be submitted by the district to the Department of Health and Senior Services (MDHSS).

SIGNATURE(S)

OCCU-TEC appreciates the opportunity to provide the above referenced consulting services to the JSD. If you have any questions regarding the contents of this report, please contact us at (816) 231-5580.

Respectfully,



Nathaniel Jones
Environmental Technician




Jeff Smith
Senior Project Manager (QA/QC)


ATTACHMENTS


- Outlet Inventory with Analytical Results Summary
- Laboratory Analytical Results and COC Documentation

ATTACHMENT 1
OUTLET INVENTORY WITH ANALYTICAL RESULTS SUMMARY


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-01	Location:	Nurse's Office	
Photo:		Manufacturer:	Sloan	
		Description:		
		Restroom Sink		
		Result:	1.4	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


ID:	235-NVE-02	Location:	Principal's Office	
Photo:		Manufacturer:	Sloan	
		Description:		
		Restroom Sink		
		Result:	<1.0	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ID:	235-NVE-03	Location:	CL-209	
Photo:		Manufacturer:	Sloan	
		Description:		
		Classroom Sink		
		Result:	15.9	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:		Replace Fixture/Unit and Resample		


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-04	Location:	CL-209		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Drinking Fountain Bubbler (Non-Functional)			
		Result:	N/A	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


ID:	235-NVE-05	Location:	CL-208		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Sink			
		Result:	8.1	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ
Replace Fixture/Unit and Resample					

ID:	235-NVE-06	Location:	CL-208		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Drinking Fountain Bubbler			
		Result:	1.8	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-07	Location:	CL-207
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	9.4
Recommended Action:		Replace Fixture/Unit and Resample	
Date Sampled:		8/9/2023	By: NJ


ID:	235-NVE-08	Location:	CL-207
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Low Flow, not Sampled)	
		Result:	N/A
Recommended Action:			
Date Sampled:		8/9/2023	By: NJ

ID:	235-NVE-09	Location:	228 Faculty RR
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink	
		Result:	<1.0
Recommended Action:			
Date Sampled:		8/9/2023	By: NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-10	Location:	CL-204
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	10.4
Recommended Action:		Replace Fixture/Unit and Resample	
Date Sampled:		8/9/2023	By: NJ


ID:	235-NVE-11	Location:	CL-204
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non-Functional)	
		Result:	N/A
Recommended Action:			
Date Sampled:		8/9/2023	By: NJ

ID:	235-NVE-12	Location:	235 Boys' Restroom
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink Basin, Left	
		Result:	<1.0
Recommended Action:			
Date Sampled:		8/9/2023	By: NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-13	Location:	235 Boy's Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Right		
		Result:	<1.0	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


ID:	235-NVE-14	Location:	200 Hall East	
Photo:		Manufacturer:	Halsey-Taylor	
		Description:		
		In-Wall Drinking Fountain Bubbler		
		Result:	<1.0	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ID:	235-NVE-15	Location:	236 Girls' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Left		
		Result:	4.7	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-16	Location:	236 Girls' Restroom
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink Basin, Right	
		Result:	9.7
Recommended Action:		Replace Fixture/Unit and Resample	
Date Sampled:		8/9/2023	By: NJ


ID:	235-NVE-17	Location:	CL-203
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	15.1
Recommended Action:		Replace Fixture/Unit and Resample	
Date Sampled:		8/9/2023	By: NJ

ID:	235-NVE-18	Location:	CL-203
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non Functional)	
		Result:	N/A
Recommended Action:			
Date Sampled:		8/9/2023	By: NJ

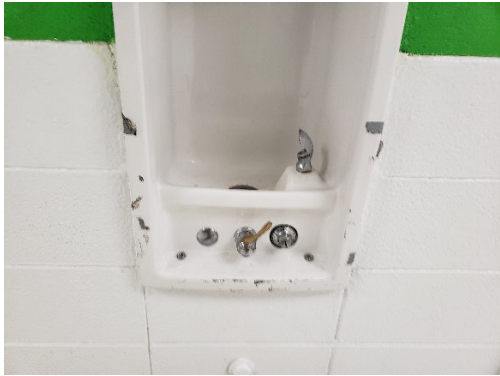
Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-19	Location:	CL-201
Photo:		Manufacturer:	Unknown
		Description:	
		Art Room Sink, Teacher's Desk	
Result:		1.8	ppb
Date Sampled:		8/9/2023	By: NJ
Recommended Action:			

ID:	235-NVE-20	Location:	CL-218
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink (Non-Functional)	
Result:		N/A	ppb
Date Sampled:		8/9/2023	By: NJ
Recommended Action:			

ID:	235-NVE-21	Location:	CL-218
Photo:		Manufacturer:	American Standard
		Description:	
		Class Drinking Fountain Bubbler (Non-Functional)	
Result:		N/A	ppb
Date Sampled:		8/9/2023	By: NJ
Recommended Action:			


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-22	Location:	200 Hall West
Photo:		Manufacturer:	Halsey-Taylor
		Description:	
		In-Wall Drinking Fountain Bubbler	
		Result:	4.5
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

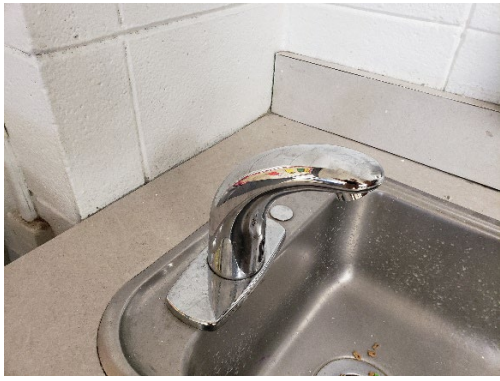
ID:	235-NVE-23	Location:	232 Girls' Restroom
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink Basin, Left (No Sensor)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-24	Location:	232 Girls' Restroom
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink Basin, Right	
		Result:	5.7
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ
Replace Fixture/Unit and Resample			


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-25	Location:	231 Boys' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Left		
		Result:	1	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


ID:	235-NVE-26	Location:	231 Boys' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Right		
		Result:	1.2	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ID:	235-NVE-27	Location:	CL-217	
Photo:		Manufacturer:	Sloan	
		Description:		
		Classroom Sink		
		Result:	9.8	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:		Replace Fixture/Unit and Resample		


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-28	Location:	CL-217
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Low Flow, No Sample)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


ID:	235-NVE-29	Location:	CL-214
Photo:		Manufacturer:	Sloan
		Description:	
		Classroom Sink	
		Result:	4.8
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-30	Location:	CL-214
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


Drinking Water Assessment
 Northview Elementary School
 Jennings School District

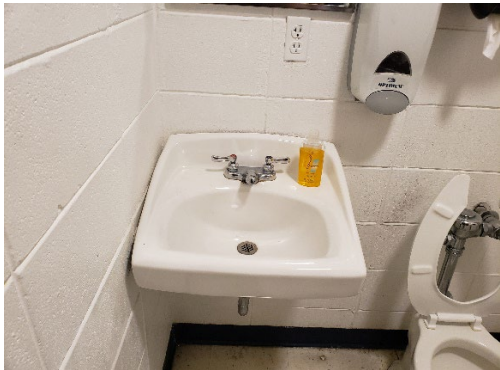
ID:	235-NVE-31	Location:	CL-212		
Photo:		Manufacturer:	Sloan		
		Description:			
		Classroom Sink			
		Result:	1.3	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


ID:	235-NVE-32	Location:	CL-212		
Photo:		Manufacturer:	American Standard		
		Description:			
		Class Drinking Fountain Bubbler (Non-Functional)			
		Result:	N/A	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ

ID:	235-NVE-33	Location:	CL-211		
Photo:		Manufacturer:	Sloan		
		Description:			
		Classroom Sink			
		Result:	4.7	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-34	Location:	CL-211
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


ID:	235-NVE-35	Location:	233 Gymnasium
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink	
		Result:	37.3
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ
Replace Fixture/Unit and Resample			

ID:	235-NVE-36	Location:	102 Kitchen Restroom
Photo:		Manufacturer:	Chicago Faucet Co.
		Description:	
		Restroom Sink	
		Result:	1.5
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-37	Location:	Kitchen	
Photo:		Manufacturer:	Chicago Faucet Co.	
		Description:		
		Hand Washing Sink, East Wall		
		Result:	15	ppb
Recommended Action:		Replace Fixture/Unit and Resample		
		Date Sampled:	8/9/2023	By: NJ

ID:	235-NVE-38	Location:	Kitchen	
Photo:		Manufacturer:	Chicago Faucet Co.	
		Description:		
		East Wall Sink		
		Result:	<1.0	ppb
Recommended Action:				
		Date Sampled:	8/9/2023	By: NJ

ID:	235-NVE-39	Location:	Kitchen	
Photo:		Manufacturer:	Chicago Faucet Co.	
		Description:		
		Dishwashing Station Sink, Right		
		Result:	<1.0	ppb
Recommended Action:				
		Date Sampled:	8/9/2023	By: NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-40	Location:	Kitchen	
Photo:		Manufacturer:	Chicago Faucet Co.	
		Description:		
		Dishwashing Station Sink, Left		
		Result:	1.3	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ

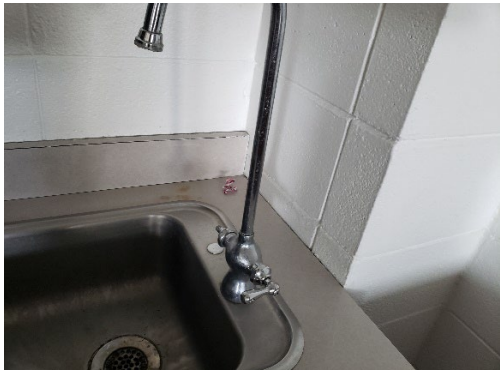
ID:	235-NVE-41	Location:	Kitchen	
Photo:		Manufacturer:	UPC	
		Description:		
		Hand Washing Sink, 129 Cust. Closet		
		Result:	44.9	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ
Replace Fixture/Unit and Resample				

ID:	235-NVE-42	Location:	Kitchen	
Photo:		Manufacturer:	Fisher USA	
		Description:		
		Kitchen Dish Sprayer (Non-Functional)		
		Result:	N/A	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-43	Location:	Cafeteria		
Photo:		Manufacturer:	Elkay		
		Description:			
		Standalone Drinking Fountain Bubbler (Non-Functional)			
		Result:	N/A	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


ID:	235-NVE-44	Location:	Cafeteria		
Photo:		Manufacturer:	Manitowoc		
		Description:			
		Ice Machine (Non-Functional)			
		Result:	N/A	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ

ID:	235-NVE-45	Location:	CL-103		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Sink			
		Result:	4.4	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ

Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-46	Location:	CL-103		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Drinking Fountain Bubbler			
		Result:	3.1	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


ID:	235-NVE-47	Location:	CL-105		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Sink			
		Result:	21.1	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ
Replace Fixture/Unit and Resample					

ID:	235-NVE-48	Location:	CL-105		
Photo:		Manufacturer:	American Standard		
		Description:			
		Classroom Drinking Fountain Bubbler (Non-Functional)			
		Result:	N/A	ppb	
Recommended Action:		Date Sampled:	8/9/2023	By:	NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-49	Location:	E100 Hallway	
Photo:		Manufacturer:	Halsey-Taylor	
		Description:		
		In-Wall Drinking Fountain Bubbler (Taped off, No Sample)		
		Result:	N/A	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


ID:	235-NVE-50	Location:	126 Girls' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Left (Non-Functional)		
		Result:	N/A	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ID:	235-NVE-51	Location:	126 Girls' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Right (Non-Functional)		
		Result:	N/A	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-52	Location:	125 Boys' Restroom
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink Basin, Left (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


ID:	235-NVE-53	Location:	125 Boys' Restroom
Photo:		Manufacturer:	Unknown
		Description:	
		Restroom Sink Basin, Right (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-54	Location:	128 Faculty Restroom
Photo:		Manufacturer:	Sloan
		Description:	
		Restroom Sink	
		Result:	<1.0
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

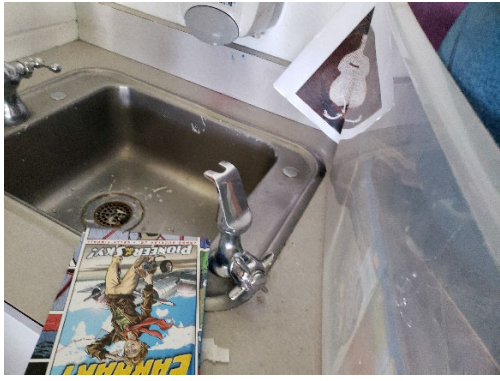
Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-55	Location:	CL-106
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink (Low Flow, No Sample)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


ID:	235-NVE-56	Location:	CL-106
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-57	Location:	CL-108
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	6.4
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ
Replace Fixture/Unit and Resample			


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-58	Location:	CL-108
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


ID:	235-NVE-59	Location:	CL-109
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-60	Location:	CL-109
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Non-Functional)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-61	Location:	CL-110
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	15.3
Recommended Action:		Replace Fixture/Unit and Resample	
Date Sampled:		8/9/2023	By: NJ


ID:	235-NVE-62	Location:	CL-110
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler	
		Result:	3.1
Recommended Action:			
Date Sampled:		8/9/2023	By: NJ

ID:	235-NVE-63	Location:	CL-112
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	17
Recommended Action:		Replace Fixture/Unit and Resample	
Date Sampled:		8/9/2023	By: NJ


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-64	Location:	CL-112
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler (Low Flow, No Sample)	
		Result:	N/A
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ


ID:	235-NVE-65	Location:	CL-113
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Sink	
		Result:	52.7
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ
Replace Fixture/Unit and Resample			

ID:	235-NVE-66	Location:	CL-113
Photo:		Manufacturer:	American Standard
		Description:	
		Classroom Drinking Fountain Bubbler	
		Result:	7
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ
Replace Fixture/Unit and Resample			


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-67	Location:	116 Counselor's Office
Photo:		Manufacturer:	Chicago Faucet Co.
		Description:	Office Sink
		Result:	11.8 ppb
		Date Sampled:	8/9/2023 By: NJ
Recommended Action:	Replace Fixture/Unit and Resample		


ID:	235-NVE-68	Location:	CL-115
Photo:		Manufacturer:	American Standard
		Description:	Classroom Sink
		Result:	13.9 ppb
		Date Sampled:	8/9/2023 By: NJ
Recommended Action:	Replace Fixture/Unit and Resample		

ID:	235-NVE-69	Location:	CL-115
Photo:		Manufacturer:	American Standard
		Description:	Classroom Drinking Fountain Bubbler (Non-Functional)
		Result:	N/A ppb
		Date Sampled:	8/9/2023 By: NJ
Recommended Action:			


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-70	Location:	130 Faculty Restroom	
Photo:		Manufacturer:	Sloan	
		Description:		
		Restroom Sink		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ


ID:	235-NVE-71	Location:	West 100 Hall	
Photo:		Manufacturer:	Halsey-Taylor	
		Description:		
		In-Wall Drinking Fountain Bubbler		
		Result:	4.5	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ

ID:	235-NVE-72	Location:	131 Boys' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Left		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ

Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-73	Location:	131 Boys' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Right		
		Result:	<1.0	
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


ID:	235-NVE-74	Location:	132 Girls' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Left		
		Result:	1	
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ID:	235-NVE-75	Location:	132 Girls' Restroom	
Photo:		Manufacturer:	Unknown	
		Description:		
		Restroom Sink Basin, Right		
		Result:	1.4	
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				


Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-76	Location:	100 Hall South Restroom	
Photo:		Manufacturer:	Sloan	
		Description:		
		Restroom Sink		
		Result:	1.2	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ


ID:	235-NVE-77	Location:	100 Hall South Restroom	
Photo:		Manufacturer:	Sloan	
		Description:		
		Restroom Drinking Fountain Bubbler		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ

ID:	235-NVE-78	Location:	149/150 Restrooms	
Photo:		Manufacturer:	Elkay	
		Description:		
		Drinking Fountain Bubbler, Left		
		Result:	<1.0	ppb
Recommended Action:		Date Sampled:	8/9/2023	By: NJ

Drinking Water Assessment
Northview Elementary School
Jennings School District


ID:	235-NVE-79	Location:	149/150 Restrooms
Photo:		Manufacturer:	Elkay
		Description:	
		Drinking Fountain Bubbler, Right	
		Result:	<1.0
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-80	Location:	149 Girls' Restroom
Photo:		Manufacturer:	American Standard
		Description:	
		Restroom Sink, Left	
		Result:	<1.0
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

ID:	235-NVE-81	Location:	149 Girls' Restroom
Photo:		Manufacturer:	Sloan
		Description:	
		Restroom Sink, Right	
		Result:	<1.0
Recommended Action:		Date Sampled:	8/9/2023
		By:	NJ

Drinking Water Assessment
 Northview Elementary School
 Jennings School District

ID:	235-NVE-82	Location:	150 Boys' Restroom	
Photo:		Manufacturer:	Sloan	
		Description:		
		Restroom Sink, Left (Non-Functional)		
		Result:	N/A	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ID:	235-NVE-83	Location:	150 Boys' Restroom	
Photo:		Manufacturer:	American Standard	
		Description:		
		Restroom Sink, Right		
		Result:	1	ppb
Date Sampled:		8/9/2023	By:	NJ
Recommended Action:				

ATTACHMENT 2

LABORATORY ANALYTICAL RESULTS AND COC DOCUMENTATION

September 18, 2023

Kevin Heriford
Occu-Tec
2604 NE Industrial Drive
Suite 230
North Kansas, MO 64117
TEL: (816) 231-5580
FAX:



Illinois	100226
Kansas	E-10374
Louisiana	05002
Louisiana	05003
Oklahoma	9978

RE: 923235 NVE

WorkOrder: 23080942

Dear Kevin Heriford:

TEKLAB, INC received 55 samples on 8/11/2023 11:00:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Patrick Riley
Project Manager
(618)344-1004 ex 44
patrickriley@teklabinc.com



Report Contents

<http://www.teklabinc.com/>

Client: Occu-Tec

Work Order: 23080942

Client Project: 923235 NVE

Report Date: 18-Sep-23

This reporting package includes the following:

Cover Letter	1
Report Contents	2
Definitions	3
Case Narrative	5
Accreditations	6
Laboratory Results	7
Receiving Check List	62
Chain of Custody	Appended

Client: Occu-Tec

Work Order: 23080942

Client Project: 923235 NVE

Report Date: 18-Sep-23

Abbr Definition

* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

Client: Occu-Tec

Work Order: 23080942

Client Project: 923235 NVE

Report Date: 18-Sep-23

Qualifiers

- # - Unknown hydrocarbon
- C - RL shown is a Client Requested Quantitation Limit
- H - Holding times exceeded
- J - Analyte detected below quantitation limits
- ND - Not Detected at the Reporting Limit
- S - Spike Recovery outside recovery limits
- X - Value exceeds Maximum Contaminant Level
- B - Analyte detected in associated Method Blank
- E - Value above quantitation range
- I - Associated internal standard was outside method criteria
- M - Manual Integration used to determine area response
- R - RPD outside accepted recovery limits
- T - TIC(Tentatively identified compound)



Case Narrative

<http://www.teklabinc.com/>

Client: Occu-Tec

Work Order: 23080942

Client Project: 923235 NVE

Report Date: 18-Sep-23

Cooler Receipt Temp: N/A °C

Locations

Collinsville

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425

Phone (618) 344-1004

Fax (618) 344-1005

Email jhriley@teklabinc.com

Collinsville Air

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425

Phone (618) 344-1004

Fax (618) 344-1005

Email EHurley@teklabinc.com

Springfield

Address 3920 Pintail Dr
Springfield, IL 62711-9415

Phone (217) 698-1004

Fax (217) 698-1005

Email KKlostermann@teklabinc.com

Chicago

Address 1319 Butterfield Rd.
Downers Grove, IL 60515

Phone (630) 324-6855

Fax

Email arenner@teklabinc.com

Kansas City

Address 8421 Nieman Road
Lenexa, KS 66214

Phone (913) 541-1998

Fax (913) 541-1998

Email jhriley@teklabinc.com



Accreditations

<http://www.teklabinc.com/>

Client: Occu-Tec

Work Order: 23080942

Client Project: 923235 NVE

Report Date: 18-Sep-23

State	Dept	Cert #	NELAP	Exp Date	Lab
Illinois	IEPA	100226	NELAP	1/31/2024	Collinsville
Kansas	KDHE	E-10374	NELAP	4/30/2024	Collinsville
Louisiana	LDEQ	05002	NELAP	6/30/2024	Collinsville
Louisiana	LDEQ	05003	NELAP	6/30/2024	Collinsville
Oklahoma	ODEQ	9978	NELAP	8/31/2023	Collinsville
Arkansas	ADEQ	88-0966		3/14/2024	Collinsville
Illinois	IDPH	17584		5/31/2025	Collinsville
Iowa	IDNR	430		6/1/2024	Collinsville
Kentucky	UST	0073		1/31/2024	Collinsville
Missouri	MDNR	00930		5/31/2023	Collinsville
Missouri	MDNR	930		1/31/2025	Collinsville



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-001
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-01
Collection Date: 08/11/2023 7:20

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.4	µg/L	1	09/14/2023 3:18	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-002
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-02
Collection Date: 08/11/2023 7:21

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 3:21	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-003
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-03
Collection Date: 08/11/2023 7:23

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		15.9	µg/L	5	09/14/2023 18:03	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-004
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-05
Collection Date: 08/11/2023 7:27

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		8.1	µg/L	1	09/14/2023 3:25	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-005
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-06
Collection Date: 08/11/2023 7:28

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.8	µg/L	1	09/14/2023 3:28	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-006
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-07
Collection Date: 08/11/2023 7:30

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		9.4	µg/L	1	09/14/2023 3:31	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-007
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-09
Collection Date: 08/11/2023 7:33

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 3:35	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-008
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-10
Collection Date: 08/11/2023 7:34

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		10.4	µg/L	1	09/14/2023 3:38	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-009
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-12
Collection Date: 08/11/2023 7:36

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 3:41	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-010
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-13
Collection Date: 08/11/2023 7:38

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 3:45	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-011
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-14
Collection Date: 08/11/2023 7:41

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/15/2023 22:23	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-012
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-15
Collection Date: 08/11/2023 7:45

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		4.7	µg/L	1	09/15/2023 22:34	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-013
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-16
Collection Date: 08/11/2023 7:44

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		9.7	µg/L	5	09/14/2023 18:07	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-014
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-17
Collection Date: 08/11/2023 7:47

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		15.1	µg/L	1	09/15/2023 22:38	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-015
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-19
Collection Date: 08/11/2023 7:50

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.8	µg/L	1	09/15/2023 22:52	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-016
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-22
Collection Date: 08/11/2023 7:55

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		4.5	µg/L	1	09/15/2023 22:56	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-017
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-24
Collection Date: 08/11/2023 7:58

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		5.7	µg/L	1	09/15/2023 23:00	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-018
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-25
Collection Date: 08/11/2023 8:02

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.0	µg/L	1	09/15/2023 23:03	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-019
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-26
Collection Date: 08/11/2023 8:03

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.2	µg/L	1	09/15/2023 23:07	210852



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-020
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-27
Collection Date: 08/11/2023 8:05

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		9.8	µg/L	5	09/14/2023 18:11	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-021
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-29
Collection Date: 08/11/2023 8:08

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		4.8	µg/L	5	09/14/2023 18:14	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-022
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-31
Collection Date: 08/11/2023 8:10

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.3	µg/L	1	09/14/2023 22:01	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-023
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-33
Collection Date: 08/11/2023 8:13

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		4.7	µg/L	5	09/14/2023 18:29	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-024
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-35
Collection Date: 08/11/2023 8:16

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		37.3	µg/L	5	09/14/2023 18:33	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-025
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-36
Collection Date: 08/11/2023 8:18

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.5	µg/L	1	09/14/2023 22:04	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-026
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-37
Collection Date: 08/11/2023 8:28

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		15.0	µg/L	1	09/14/2023 22:08	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-027
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-38
Collection Date: 08/11/2023 8:29

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 22:12	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-028
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-39
Collection Date: 08/11/2023 8:30

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 22:15	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-029
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-40
Collection Date: 08/11/2023 8:31

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.3	µg/L	1	09/14/2023 22:37	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-030
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-41
Collection Date: 08/11/2023 8:31

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		44.9	µg/L	5	09/14/2023 18:36	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-031
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-45
Collection Date: 08/11/2023 8:36

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		4.4	µg/L	1	09/14/2023 22:41	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-032
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-46
Collection Date: 08/11/2023 8:37

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		3.1	µg/L	1	09/13/2023 22:58	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-033
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-47
Collection Date: 08/11/2023 8:38

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		21.1	µg/L	5	09/14/2023 18:40	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-034
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-54
Collection Date: 08/11/2023 8:51

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/13/2023 23:02	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-035
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-57
Collection Date: 08/11/2023 8:55

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		6.4	µg/L	1	09/13/2023 23:06	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-036
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-61
Collection Date: 08/11/2023 8:58

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		15.3	µg/L	1	09/13/2023 23:09	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-037
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-62
Collection Date: 08/11/2023 8:59

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		3.1	µg/L	1	09/13/2023 23:20	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-038
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-63
Collection Date: 08/11/2023 9:01

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		17.0	µg/L	1	09/13/2023 23:24	210856



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-039
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-65
Collection Date: 08/11/2023 9:04

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		52.7	µg/L	5	09/14/2023 18:51	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-040
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-66
Collection Date: 08/11/2023 9:05

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		7.0	µg/L	1	09/13/2023 23:28	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-041
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-67
Collection Date: 08/11/2023 9:08

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		11.8	µg/L	5	09/14/2023 18:55	210908



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-042
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-68
Collection Date: 08/11/2023 9:09

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		13.9	µg/L	1	09/13/2023 23:31	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-043
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-70
Collection Date: 08/11/2023 9:11

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 22:44	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-044
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-71
Collection Date: 08/11/2023 9:14

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		4.5	µg/L	1	09/14/2023 22:48	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-045
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-72
Collection Date: 08/11/2023 9:15

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 22:52	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-046
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-73
Collection Date: 08/11/2023 9:17

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 22:55	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-047
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-74
Collection Date: 08/11/2023 9:19

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.0	µg/L	1	09/14/2023 23:06	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-048
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-75
Collection Date: 08/11/2023 9:20

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.4	µg/L	1	09/14/2023 23:21	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-049
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-76
Collection Date: 08/11/2023 9:24

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.2	µg/L	1	09/14/2023 23:25	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-050
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-77
Collection Date: 08/11/2023 9:25

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 23:28	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-051
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-78
Collection Date: 08/11/2023 9:28

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 23:32	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-052
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-79
Collection Date: 08/11/2023 9:29

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 23:43	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-053
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-80
Collection Date: 08/11/2023 9:30

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 23:47	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-054
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-81
Collection Date: 08/11/2023 9:31

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		< 1.0	µg/L	1	09/14/2023 23:50	210853



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 NVE
Lab ID: 23080942-055
Matrix: DRINKING WATER

Work Order: 23080942
Report Date: 18-Sep-23
Client Sample ID: 235-NVE-83
Collection Date: 08/11/2023 9:33

Analyses	Certification	RL	Qual	Result	Units	DF	Date Analyzed	Batch
EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL)								
Lead	NELAP	1.0		1.0	µg/L	1	09/14/2023 23:54	210853



Receiving Check List

<http://www.teklabinc.com/>

Client: Occu-Tec

Work Order: 23080942

Client Project: 923235 NVE

Report Date: 18-Sep-23

Carrier: Employee

Received By: AMD

Completed by:

Amber Dilallo

Reviewed by:

Ellie Hopkins

On:

11-Aug-23

Amber Dilallo

On:

11-Aug-23

Ellie Hopkins

Pages to follow: Chain of custody

Extra pages included

- Shipping container/cooler in good condition? Yes No Not Present Temp °C **N/A**
- Type of thermal preservation? None Ice Blue Ice Dry Ice
- Chain of custody present? Yes No
- Chain of custody signed when relinquished and received? Yes No
- Chain of custody agrees with sample labels? Yes No
- Samples in proper container/bottle? Yes No
- Sample containers intact? Yes No
- Sufficient sample volume for indicated test? Yes No
- All samples received within holding time? Yes No
- Reported field parameters measured: Field Lab NA
- Container/Temp Blank temperature in compliance? Yes No

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

- Water – at least one vial per sample has zero headspace? Yes No No VOA vials
- Water - TOX containers have zero headspace? Yes No No TOX containers
- Water - pH acceptable upon receipt? Yes No NA
- NPDES/CWA TCN interferences checked/treated in the field? Yes No NA

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival in the laboratory. - amberdilallo - 8/11/2023 11:04:43 AM

CHAIN OF CUSTODY

pg. 1 of 5 Work order # 23080942

TEKLAB, INC. 5445 Horseshoe Lake Road - Collinsville, IL 62234 - Phone: (618) 344-1004 - Fax: (618) 344-1005

Client: <u>Occu-Tec</u> Address: <u>2604 NE Industrial Dr #230</u> City / State / Zip: <u>North Kansas City MO 64117</u> Contact: <u>Kevin Herford</u> Phone: <u>816-925-0628</u> E-Mail: <u>kherford@occutec.com</u> Fax: _____	Samples on: <input checked="" type="checkbox"/> ICE <input checked="" type="checkbox"/> BLUE ICE <input checked="" type="checkbox"/> NO ICE <u>N/A</u> °C LTG# _____ Preserved in: <input checked="" type="checkbox"/> LAB <input type="checkbox"/> FIELD FOR LAB USE ONLY Lab Notes Client Comments: <div style="text-align: center; font-size: 2em; font-family: cursive;">5 ppb</div>
---	---

Are these samples known to be involved in litigation? If yes, a surcharge will apply Yes No
 Are these samples known to be hazardous? Yes No
 Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section. Yes No

Project Name/Number		Sample Collector's Name		MATRIX		INDICATE ANALYSIS REQUESTED														
923235 <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge)		Nate Jones		# and Type of Containers UNPRES HNO3 NaOH H2SO4 HCL MeOH NaHSO4 OTHER		Aqueous Drinking Water Soil Sludge Special Waste Groundwater	(Grid with handwritten 'X' in the first column and 'DP' in the second column)													
																	Lab Use Only	Sample Identification	Date/Time Sampled	
23080942-001	235-NVE-01	8/11/23	7:20																	
002	235-NVE-02	8/11/23	7:21																	
003	235-NVE-03	8/11/23	7:23																	
004	235-NVE-05	8/11/23	7:27																	
005	235-NVE-06	8/11/23	7:28																	
006	235-NVE-07	8/11/23	7:30																	
007	235-NVE-09	8/11/23	7:33																	
008	235-NVE-10	8/11/23	7:34																	
009	235-NVE-12	8/11/23	7:36																	
010	235-NVE-13	8/11/23	7:38																	
Relinquished By		Date/Time		Received By		Date/Time														
		8-11-23				8/11/23 1100														

The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions.

