



**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 07/06/2016  
Received: 06/15/2016  
Sampled By:  
Work Order: 6168035

**C** Clatskanie, City of  
**L** Attn: Daniel Smith  
**I** 75 S Nehalem Ste D  
**E** Clatskanie OR, 97016  
**N** Phone: (503) 728-2622  
**T**

**Project:** Lead  
Project # : N/A  
PWSID # :

Sampling Location: Clataksanie Elementary


**Lab Number**

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>6168035-06</b>	<b>Sample Name:</b> 1 Teachers Lounge		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/15/16 6:35		<b>Sample Composition:</b> Treated Source Single				
†Lead	1030	EPA 200.9	2.8	ppb	2.0	20 ppb	06/25/16 15:53
<b>6168035-07</b>	<b>Sample Name:</b> 2 Drinking Fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/15/16 6:36		<b>Sample Composition:</b> Treated Source Single				
†Lead	1030	EPA 200.9	2.2	ppb	2.0	20 ppb	07/01/16 15:46
<b>6168035-08</b>	<b>Sample Name:</b> 3 Kitchen Sink		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/15/16 6:12		<b>Sample Composition:</b> Treated Source Single				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	06/25/16 15:53
<b>6168035-09</b>	<b>Sample Name:</b> 4 East WIng Teachers Lounge		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/15/16 6:14		<b>Sample Composition:</b> Treated Source Single				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	06/25/16 15:53
<b>6168035-10</b>	<b>Sample Name:</b> 5 Hallway Drinking Fountain		<b>Matrix:</b> Water				
	<b>Sampled:</b> 6/15/16 6:25		<b>Sample Composition:</b> Treated Source Single				
†Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	06/25/16 15:53

**ND** = None detected at the MRL    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit  
†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is an action level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: \_\_\_\_\_

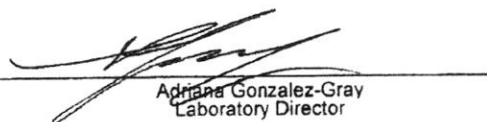

Adriana Gonzalez-Gray  
Laboratory Director