
October 3, 2023

Mr. Henry Ilges
Jennings School District
2559 Dorwood Drive
Jennings, MO 64136

RE: Drinking Water Sampling – Jennings Senior High School
8850 Cozens Avenue
Jennings, MO 63136
Project Number: 923235

Mr. Ilges,

OCCU-TEC, Inc. (OCCU-TEC) is pleased to present the following report for drinking water sampling completed at Jennings Senior High School in Jennings, Missouri. The sampling was requested and approved by Mr. Henry Ilges of Jennings School District (JSD). OCCU-TEC completed drinking water sampling of all potential drinking water sources, sources used in food preparation, cleaning, and utensil cleaning. Drinking water sampling was completed in accordance with the requirements set forth in Missouri Senate Bill #681/662 known as the "Get the Lead Out of School Drinking Water Act".

METHODOLOGY

On August 10, 2023, Mr. Jeff Smith and Mr. Nathaniel Jones of OCCU-TEC completed testing of one hundred fifteen (115) sources throughout Jennings Senior High School. Samples were collected as 'First Draw' samples after the fixtures had remained unused for a minimum period of 8 hours. Samples were collected in dedicated, laboratory-provided 250-milliliter plastic sample containers. Sample location information and photographic documentation are noted in the attached table.

Samples were shipped to Teklab, Inc. (Teklab) of Collinsville, Illinois for analysis using EPA method 200.8. Teklab is approved for sample analysis by the Missouri Department of Natural Resources (MDNR) under certification number 00930. A copy of the laboratory analytical results and Chain of Custody documentation are attached to this report.

RESULTS

Samples results were compared to the regulatory limit of 5 parts per billion (ppb) outlined in Missouri Senate Bill 681/662. Of the samples collected, thirty-one (31) of the one hundred fifteen (115) contained lead concentrations at or above 5 ppb. Below is a list of samples containing elevated concentrations of lead.

| Sample ID | Location | Type | Result (ug/L) |
|------------------|-------------------------------------|--------------------------------------|----------------------|
| 235-JHS-01 | P-100 Pool Lobby | Standalone Drinking Fountain Bubbler | 6.8 |
| 235-JHS-04 | Pool Men's Locker | Locker Room Sink | 208 |
| 235-JHS-05 | Pool Men's Locker | Locker Room Sink | 106 |
| 235-JHS-06 | Pool Men's Restroom | Restroom Sink | 26.1 |
| 235-JHS-07 | Pool Women's Restroom | Restroom Sink | 257 |
| 235-JHS-10 | Auditorium Men's Restroom | Restroom Sink | 21.6 |
| 235-JHS-12 | Auditorium Women's Restroom | Restroom Sink | 41.2 |
| 235-JHS-14 | S218 | Classroom Sink | 5.7 |
| 235-JHS-15 | S215 | Science Closet Sink | 221 |
| 235-JHS-16 | S220 | Science Classroom Sink | 526 |
| 235-JHS-20 | S200 Men's Restroom | Restroom Sink | 32.7 |
| 235-JHS-27 | S222 Science Lab | Lab Sink | 23.5 |
| 235-JHS-28 | E222 Lab Closet | Lab Sink | 73.8 |
| 235-JHS-36 | E137, FACS | FACS Station Sink | 13.8 |
| 235-JHS-38 | E137, FACS | FACS Station Sink | 6.4 |
| 235-JHS-39 | E137, FACS | FACS Station Sink | 5.5 |
| 235-JHS-43 | Gym, Upper Concession | Concession Sink | 77.6 |
| 235-JHS-47 | Gym Women's Locker | Locker Room Sink | 13.3 |
| 235-JHS-53 | EG4 Locker Room Office | Restroom Sink | 5.3 |
| 235-JHS-61 | Football Concession Girls' Restroom | Restroom Sink | 8.7 |
| 235-JHS-82 | Kitchen | Hand Washing Sink | 16.2 |
| 235-JHS-83 | Kitchen | Center Island Sink | 23.1 |
| 235-JHS-84 | Kitchen | Center Island Sink | 8.2 |
| 235-JHS-87 | Kitchen | Pot Filler | 48 |
| 235-JHS-96 | Cafeteria Service Area | Hand Washing Sink | 207 |
| 235-JHS-102 | Cafeteria Men's Restroom | Restroom Sink | 7.6 |
| 235-JHS-108 | A172 Women's Locker | Restroom Sink | 30.2 |
| 235-JHS-114 | A169 Men's Locker | Restroom Sink | 8 |
| 235-JHS-120 | A100 Art Room | Art Room Sink 1 | 8 |

| | | | |
|-------------|---------------|--------------------|------|
| 235-JHS-123 | A100 Art Room | Art Room Sink 4 | 86.8 |
| 235-JHS-139 | Clinic Room 2 | Clinic Office Sink | 17.3 |

LIMITATIONS

At the request of JSD, janitorial closet sinks were excluded from sampling. OCCU-TEC recommends placing signage on all sources not sampled during this assessment that indicate the source is not to be used for drinking water.

RECOMMENDATIONS

The following recommendations are in accordance with Senate Bill 681/662.

In accordance with the requirements set forth in Missouri Bill 681/662, fixtures exhibiting lead concentrations above 5 ppb must be remediated by replacement of lead-containing pipes, solder, fittings or fixtures with lead-free components, or the school shall install filtration at each point where water enters the building until such time as the source can be remediated. If installing a filter is not feasible, the school shall provide purified water at each outlet inventoried.

Additionally, any water coolers or drinking water outlets identified by the United States Environmental Protection Agency (EPA) as not being lead-free under the federal Lead Contamination Control Act of 1988 shall be replaced unless the unit has been tested and determined to have lead results under 5 ppb.

Within two weeks after receiving test results, the school shall make all testing results and any lead remediation plans available on the school's website. The school shall notify parents and staff via written notification within seven (7) business days after receiving test results exceeding 5 ppb. The notification shall include the following:

- Test results and a summary explaining the results.
- A description of any remedial steps taken.
- A description of the general health effects of lead contamination and community specific resources.
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.

For fixtures exhibiting results above 5 ppb, follow up random "Flush" sampling shall be conducted annually on at least 25-percent of the remediated outlets until all outlets have been remediated. Drinking water sampling shall be conducted annually and annual drinking water test results shall be submitted by the district to the Department of Health and Senior Services (MDHSS).

SIGNATURE(S)

OCCU-TEC appreciates the opportunity to provide the above referenced consulting services to the JSD. If you have any questions regarding the contents of this report, please contact us at (816) 231-5580.

Respectfully,



Nathaniel Jones
Environmental Technician



Jeff Smith
Senior Project Manager (QA/QC)


ATTACHMENTS


Outlet Inventory with Analytical Results Summary
Laboratory Analytical Results and COC Documentation


ATTACHMENT 1

OUTLET INVENTORY WITH ANALYTICAL RESULTS SUMMARY


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------------------------|------------------|-----|
| ID: | 235-JHS-01 | Location: | P-100 Pool Lobby | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler | | |
| | | Result: | 6.8 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

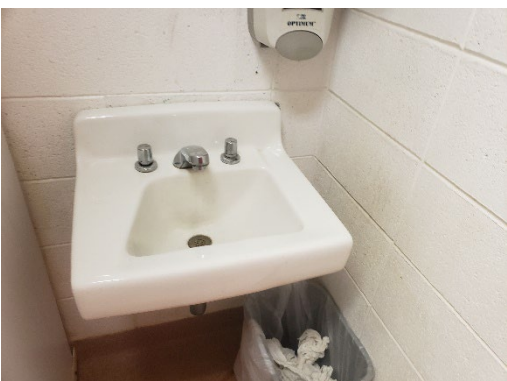
| | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------------------------------|---------------------|-----|
| ID: | 235-JHS-02 | Location: | Pool Women's Locker | |
| Photo: |  | Manufacturer: | Chicago Faucet Co. | |
| | | Description: | | |
| | | Locker Room Sink, Left (Non-Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------------------------|---------------------|-----|
| ID: | 235-JHS-03 | Location: | Pool Women's Locker | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Locker Room Sink, Right (Non-Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District

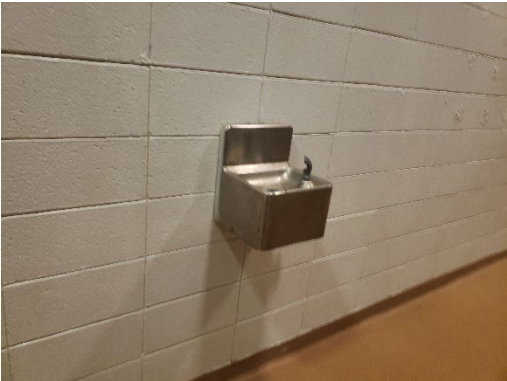
| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|-------------------|--------|
| ID: | 235-JHS-04 | Location: | Pool Men's Locker | |
| Photo: |  | Manufacturer: | Delta | |
| | | Description: | | |
| | | Locker Room Sink, Left | | |
| | | Result: | 208 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

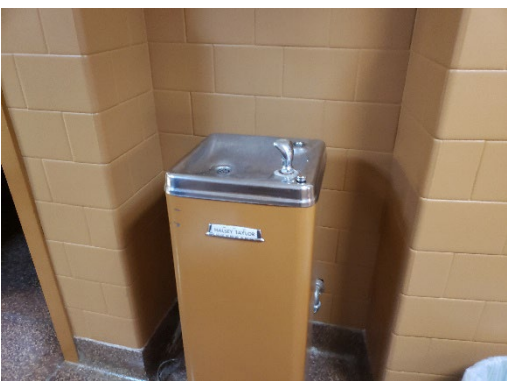
| | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------------------------|-------------------|--------|
| ID: | 235-JHS-05 | Location: | Pool Men's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Locker Room Sink, Right | | |
| | | Result: | 106 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|---------------|--------|
| ID: | 235-JHS-06 | Location: | Pool Men's RR | |
| Photo: |  | Manufacturer: | Delta | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 26.1 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|-----------------|--------|
| ID: | 235-JHS-07 | Location: | Pool Women's RR | |
| Photo: |  | Manufacturer: | Delta | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 257 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------------------------------|---------------|--------|
| ID: | 235-JHS-08 | Location: | Pool Deck | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler (Non- Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------|---------------|--------|
| ID: | 235-JHS-09 | Location: | Auditorium | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler (Non-Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|---------------------|
| ID: | 235-JHS-10 | Location: | Auditorium Men's RR |
| Photo: |  | Manufacturer: | Chicago Faucet Co. |
| | | Description: | |
| | | Restroom Sink | |
| | | Result: | 21.6 |
| | | Date Sampled: | 8/10/2023 By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | |


| | | | |
|---------------------|------------------------------------------------------------------------------------|-------------------------------------------------------|------------------|
| ID: | 235-JHS-11 | Location: | Auditorium |
| Photo: |  | Manufacturer: | Halsey-Taylor |
| | | Description: | |
| | | Standalone Drinking Fountain Bubbler (Non-Functional) | |
| | | Result: | N/A |
| | | Date Sampled: | 8/10/2023 By: NJ |
| Recommended Action: | | | |

| | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|-----------------------|
| ID: | 235-JHS-12 | Location: | Auditorium Women's RR |
| Photo: |  | Manufacturer: | Chicago Faucet Co. |
| | | Description: | |
| | | Restroom Sink, Left | |
| | | Result: | 41.2 |
| | | Date Sampled: | 8/10/2023 By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|----------------------|-----------------------|-----|----|
| ID: | 235-JHS-13 | Location: | Auditorium Women's RR | | |
| Photo: |  | Manufacturer: | Delta | | |
| | | Description: | | | |
| | | Restroom Sink, Right | | | |
| | | Result: | 4.9 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------------------|-----------|-----|----|
| ID: | 235-JHS-14 | Location: | S218 | | |
| Photo: |  | Manufacturer: | Omni | | |
| | | Description: | | | |
| | | Classroom Sink | | | |
| | | Result: | 5.7 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| | | Replace Fixture/Unit and Resample | | | |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------------------------|-----------|-----|----|
| ID: | 235-JHS-15 | Location: | S215 | | |
| Photo: |  | Manufacturer: | Hamilton | | |
| | | Description: | | | |
| | | Science Closet Sink | | | |
| | | Result: | 221 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| | | Replace Fixture/Unit and Resample | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|--------|
| ID: | 235-JHS-16 | Location: | S220 |
| Photo: |  | Manufacturer: | Omni |
| | | Description: | |
| | | Science Classroom Sink | |
| | | Result: | 526 |
| Recommended Action: | | Replace Fixture/Unit and Resample | |
| Date Sampled: | | 8/10/2023 | By: NJ |


| | | | |
|---------------------|------------------------------------------------------------------------------------|---------------------------------|-----------|
| ID: | 235-JHS-17 | Location: | S200 Hall |
| Photo: |  | Manufacturer: | Elkay |
| | | Description: | |
| | | Drinking Fountain Bottle Filler | |
| | | Result: | <1.0 |
| Recommended Action: | | | |
| Date Sampled: | | 8/10/2023 | By: NJ |

| | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------------------|-----------|
| ID: | 235-JHS-18 | Location: | S200 Hall |
| Photo: |  | Manufacturer: | Elkay |
| | | Description: | |
| | | Drinking Fountain Bubbler | |
| | | Result: | <1.0 |
| Recommended Action: | | | |
| Date Sampled: | | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------|-----------------|--------|
| ID: | 235-JHS-19 | Location: | S200 Women's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 2.1 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|-----------------------------------|------------------------------------------------------------------------------------|---------------|---------------|--------|
| ID: | 235-JHS-20 | Location: | S200 Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 32.7 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |
| Replace Fixture/Unit and Resample | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|----------------------------------|-----------|--------|
| ID: | 235-JHS-21 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | Island Lab Sink (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|------------------------------|----------|-----|
| ID: | 235-JHS-22 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | West Wall Left Lab Sink, "1" | | |
| | | Result: | 4.3 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------|----------|-----|
| ID: | 235-JHS-23 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | West Wall Center Lab Sink, "2" | | |
| | | Result: | 1.8 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------------------|----------|-----|
| ID: | 235-JHS-24 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | West Wall Right Lab Sink, "3" | | |
| | | Result: | 1.5 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|------------------------------|-----------|-----|
| ID: | 235-JHS-25 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | East Wall Left Lab Sink, "4" | | |
| | | Result: | 4.8 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------|-----------|-----|
| ID: | 235-JHS-26 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | East Wall Center Lab Sink, "5" | | |
| | | Result: | 4.2 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|-----------|-----|
| ID: | 235-JHS-27 | Location: | S222 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | East Wall Center Lab Sink, "6" | | |
| | | Result: | 23.5 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|-----------------|
| ID: | 235-JHS-28 | Location: | E222 Lab Closet |
| Photo: |  | Manufacturer: | Moen |
| | | Description: | |
| | | Lab Sink | |
| | | Result: | 73.8 |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | |


| | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------------|---------------|
| ID: | 235-JHS-29 | Location: | E220 Hall |
| Photo: |  | Manufacturer: | Halsey-Taylor |
| | | Description: | |
| | | Standalone Drinking Fountain Bubbler | |
| | | Result: | <1.0 |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |

| | | | |
|---------------------|-------------------------------------------------------------------------------------|--------------------------------------|---------------|
| ID: | 235-JHS-30 | Location: | E220 Men's RR |
| Photo: |  | Manufacturer: | Symmons |
| | | Description: | |
| | | Restroom Sink, Left (Non-Functional) | |
| | | Result: | N/A |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------------------------------|---------------|-----|----|
| ID: | 235-JHS-31 | Location: | E220 Men's RR | | |
| Photo: |  | Manufacturer: | Sloan | | |
| | | Description: | | | |
| | | Restroom Sink, Right (Non-Functional) | | | |
| | | Result: | N/A | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | | |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------------|-----------------|-----|----|
| ID: | 235-JHS-32 | Location: | E100 Women's RR | | |
| Photo: |  | Manufacturer: | Sloan | | |
| | | Description: | | | |
| | | Restroom Sink, Left | | | |
| | | Result: | 1.2 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | | |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|----------------------|-----------------|-----|----|
| ID: | 235-JHS-33 | Location: | E100 Women's RR | | |
| Photo: |  | Manufacturer: | Sloan | | |
| | | Description: | | | |
| | | Restroom Sink, Right | | | |
| | | Result: | 1.5 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|------------------------------------------|---------------|-----|
| ID: | 235-JHS-34 | Location: | E100 Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Left Wall (Chrome Faucet) | | |
| | | Result: | 1.1 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------------------|---------------|-----|
| ID: | 235-JHS-35 | Location: | E100 Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Right Wall (Black Faucet) | | |
| | | Result: | 3.2 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|------------|-----|
| ID: | 235-JHS-36 | Location: | E137, FACS | |
| Photo: |  | Manufacturer: | Unknown | |
| | | Description: | | |
| | | North West Station Sink | | |
| | | Result: | 13.8 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|-------------------------------|------------|-----|----|
| ID: | 235-JHS-37 | Location: | E137, FACS | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | East Station Sink, North Unit | | | |
| | | Result: | 2.3 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------------------|------------|-----|----|
| ID: | 235-JHS-38 | Location: | E137, FACS | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | East Station Sink, Center Unit | | | |
| | | Result: | 6.4 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| | | Replace Fixture/Unit and Resample | | | |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------------------------|------------|-----|----|
| ID: | 235-JHS-39 | Location: | E137, FACS | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | East Station Sink, Right Unit | | | |
| | | Result: | 5.5 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| | | Replace Fixture/Unit and Resample | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-------------------------|------------|--------|
| ID: | 235-JHS-40 | Location: | E137, FACS | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | South West Station Sink | | |
| | | Result: | 4.6 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------|------------|--------|
| ID: | 235-JHS-41 | Location: | E137, FACS | |
| Photo: |  | Manufacturer: | Costway | |
| | | Description: | | |
| | | Ice Machine (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------|------------------|--------|
| ID: | 235-JHS-42 | Location: | E138, Faculty RR | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 1.4 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|-----------------------|-----|
| ID: | 235-JHS-43 | Location: | Gym, Upper Concession | |
| Photo: |  | Manufacturer: | Krowne | |
| | | Description: | | |
| | | Concession Sink | | |
| | | Result: | 77.6 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

| | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------|--------------------|-----|
| ID: | 235-JHS-44 | Location: | Gym Women's Locker | |
| Photo: |  | Manufacturer: | Scotsman | |
| | | Description: | | |
| | | Ice Machine (Non-Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------|--------------------|-----|
| ID: | 235-JHS-45 | Location: | Gym Women's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Locker Room Sink, Left | | |
| | | Result: | 3.9 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------------|--------------------|-----|
| ID: | 235-JHS-46 | Location: | Gym Women's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Locker Room Sink, Center | | |
| | | Result: | 1.9 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------------------------|--------------------|-----|
| ID: | 235-JHS-47 | Location: | Gym Women's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Locker Room Sink, Right | | |
| | | Result: | 13.3 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------|-----------------------|-----|
| ID: | 235-JHS-48 | Location: | EG50 Gym Lower Office | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 1.8 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------------------------|------------------|----|
| ID: | 235-JHS-49 | Location: | Outside East Gym | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler | | |
| | | Result: | | |
| | | <1.0 ppb | | |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------------------------------|------------------|----|
| ID: | 235-JHS-50 | Location: | EG4 Men's Locker | |
| Photo: |  | Manufacturer: | Kohler | |
| | | Description: | | |
| | | Locker Room Drinking Fountain Bubbler (Non-Functional) | | |
| | | Result: | | |
| | | N/A ppb | | |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------|------------------|----|
| ID: | 235-JHS-51 | Location: | EG4 Men's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Locker Room Sink, Left | | |
| | | Result: | | |
| | | 1.8 ppb | | |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|------------------------------------------|------------------|-----|----|
| ID: | 235-JHS-52 | Location: | EG4 Men's Locker | | |
| Photo: |  | Manufacturer: | Symmons | | |
| | | Description: | | | |
| | | Locker Room Sink, Right (Non-Functional) | | | |
| | | Result: | N/A | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------------------------|----------------------|-----|----|
| ID: | 235-JHS-53 | Location: | EG4 Locker Rm Office | | |
| Photo: |  | Manufacturer: | Glacier Bay | | |
| | | Description: | | | |
| | | Restroom Sink | | | |
| | | Result: | 5.3 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| | | Replace Fixture/Unit and Resample | | | |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|----------------|-------------------|-----|----|
| ID: | 235-JHS-54 | Location: | EG3J Cust. Closet | | |
| Photo: |  | Manufacturer: | Kohler | | |
| | | Description: | | | |
| | | Custodial Sink | | | |
| | | Result: | 2.8 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------|--------|
| ID: | 235-JHS-55 | Location: | EG2 |
| Photo: |  | Manufacturer: | Delta |
| | | Description: | |
| | | Restroom Sink | |
| | | Result: | <1.0 |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |


| | | | |
|---------------------|------------------------------------------------------------------------------------|---------------|-------------|
| ID: | 235-JHS-56 | Location: | EG2 Office |
| Photo: |  | Manufacturer: | Glacier Bay |
| | | Description: | |
| | | Office Sink | |
| | | Result: | <1.0 |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |

| | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------|----------------------|
| ID: | 235-JHS-57 | Location: | Football Concessions |
| Photo: |  | Manufacturer: | UPC |
| | | Description: | |
| | | Hand Washing Sink | |
| | | Result: | 4.4 |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------------------------|-------------------------|-----|----|
| ID: | 235-JHS-58 | Location: | Football Concession RRs | | |
| Photo: |  | Manufacturer: | Halsey-Taylor | | |
| | | Description: | | | |
| | | Drinking Fountain Bubbler, Left | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------------------------------------------|-------------------------|-----|----|
| ID: | 235-JHS-59 | Location: | Football Concession RRs | | |
| Photo: |  | Manufacturer: | Halsey-Taylor | | |
| | | Description: | | | |
| | | Drinking Fountain Bubbler, Right (Non-Functional) | | | |
| | | Result: | N/A | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------|------------------------|-----|----|
| ID: | 235-JHS-60 | Location: | FB Concession Boys' RR | | |
| Photo: |  | Manufacturer: | Sloan | | |
| | | Description: | | | |
| | | Restroom Sink | | | |
| | | Result: | 2 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|-------------------------|--------|
| ID: | 235-JHS-61 | Location: | FB Concession Girls' RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom sink | | |
| | | Result: | 8.7 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |
| | | Replace Fixture/Unit and Resample | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------------------------------------|---------------|--------|
| ID: | 235-JHS-62 | Location: | E100 Hall | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler (Low Flow, No Sample) | | |
| | | Result: | N/A | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |
| | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------------------------------------------|---------------|--------|
| ID: | 235-JHS-63 | Location: | E100 Hall | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Wall-Mounted Drinking Fountain Bubbler | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |
| | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------------|---------------|--------|
| ID: | 235-JHS-64 | Location: | E100 Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Left | | |
| | | Result: | 2.2 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------|-------------------|--------|
| ID: | 235-JHS-65 | Location: | E100 Men's RR | |
| Photo: |  | Manufacturer: | American Standard | |
| | | Description: | | |
| | | Restroom Sink, Right | | |
| | | Result: | 2.8 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------|--------------------------|--------|
| ID: | 235-JHS-66 | Location: | S121 Library Main Office | |
| Photo: |  | Manufacturer: | Glacier Bay | |
| | | Description: | | |
| | | Kitchenette Sink | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------|---------------------|-----|----|
| ID: | 235-JHS-67 | Location: | S113 Teacher Lounge | | |
| Photo: |  | Manufacturer: | American Standard | | |
| | | Description: | | | |
| | | Restroom Sink | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------------------|-----------|-----|----|
| ID: | 235-JHS-68 | Location: | S118L Lab | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | Island Lab Sink (Non-Functional) | | | |
| | | Result: | N/A | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|--------------------------|-----------|-----|----|
| ID: | 235-JHS-69 | Location: | S118L Lab | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | East Wall Lab Sink, Left | | | |
| | | Result: | 3.2 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|----------------------------|-----------|-----|----|
| ID: | 235-JHS-70 | Location: | S118L Lab | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | East Wall Lab Sink, Center | | | |
| | | Result: | 4.2 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

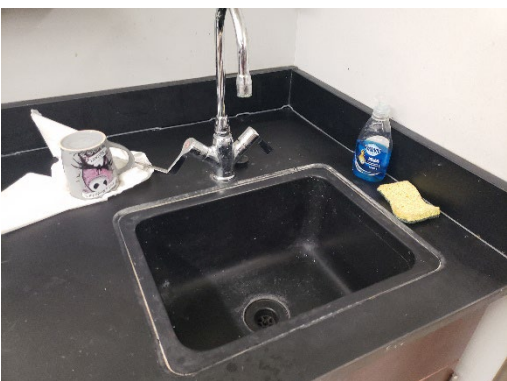
| | | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------------------|-----------|-----|----|
| ID: | 235-JHS-71 | Location: | S118L Lab | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | East Wall Lab Sink, Right | | | |
| | | Result: | 2.6 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------------|-----------|-----|----|
| ID: | 235-JHS-72 | Location: | S118L Lab | | |
| Photo: |  | Manufacturer: | Moen | | |
| | | Description: | | | |
| | | South Wall Lab Sink | | | |
| | | Result: | 4.2 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------------|-----------|-----|
| ID: | 235-JHS-73 | Location: | S118L Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | West Wall Lab Sink, Left | | |
| | | Result: | 2.7 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------------|-----------|-----|
| ID: | 235-JHS-74 | Location: | S118L Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | West Wall Lab Sink, Center | | |
| | | Result: | 3 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------------------|-----------|-----|
| ID: | 235-JHS-75 | Location: | S118 Lab | |
| Photo: |  | Manufacturer: | Moen | |
| | | Description: | | |
| | | West Wall Lab Sink, Right | | |
| | | Result: | 1.6 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------------|--------------|
| ID: | 235-JHS-76 | Location: | S118L Closet |
| Photo: |  | Manufacturer: | Moen |
| | | Description: | |
| | | Lab Sink (Obstructed Access, No Sample) | |
| | | Result: N/A ppb | |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |


| | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------|-----------------|
| ID: | 235-JHS-77 | Location: | SG8G Women's RR |
| Photo: |  | Manufacturer: | Sloan |
| | | Description: | |
| | | Restroom Sink | |
| | | Result: 1.3 ppb | |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |

| | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------|---------------|
| ID: | 235-JHS-78 | Location: | SG8B Men's RR |
| Photo: |  | Manufacturer: | Symmons |
| | | Description: | |
| | | Restroom Sink | |
| | | Result: 1.3 ppb | |
| Date Sampled: | | 8/10/2023 | By: NJ |
| Recommended Action: | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------|--------------------|-----|----|
| ID: | 235-JHS-79 | Location: | SG3A Restroom | | |
| Photo: |  | Manufacturer: | Chicago Faucet Co. | | |
| | | Description: | | | |
| | | Restroom Sink | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------|-----------|-----|----|
| ID: | 235-JHS-80 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Bunn | | |
| | | Description: | | | |
| | | Coffee Maker | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------|-----------|-----|----|
| ID: | 235-JHS-81 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Scotsman | | |
| | | Description: | | | |
| | | Ice Machine | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

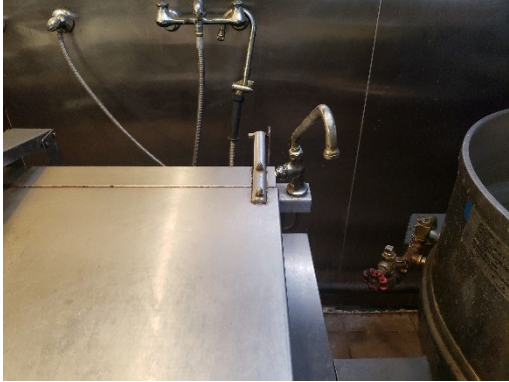
Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|-------------------------------------|-----------|-----|----|
| ID: | 235-JHS-82 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | BKR | | |
| | | Description: | | | |
| | | Hand Washing Sink, Northwest corner | | | |
| | | Result: | 16.2 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | | |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------------------------|------------|-----|----|
| ID: | 235-JHS-83 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Fisher USA | | |
| | | Description: | | | |
| | | Center Island, West Sink | | | |
| | | Result: | 23.1 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | | |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|------------|-----|----|
| ID: | 235-JHS-84 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Fisher USA | | |
| | | Description: | | | |
| | | Center Island, East Sink | | | |
| | | Result: | 8.2 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------|-----------|-----|
| ID: | 235-JHS-85 | Location: | Kitchen | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Fryer Faucet | | |
| | | Result: | 4.9 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------|-----------|-----|
| ID: | 235-JHS-86 | Location: | Kitchen | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Appliance Filler | | |
| | | Result: | 1.7 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|-----------|-----|
| ID: | 235-JHS-87 | Location: | Kitchen | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Pot Filler, Right | | |
| | | Result: | 48 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|-----------|-----|----|
| ID: | 235-JHS-88 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Unknown | | |
| | | Description: | | | |
| | | East Island Sink (Non-Functional) | | | |
| | | Result: | N/A | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | | |

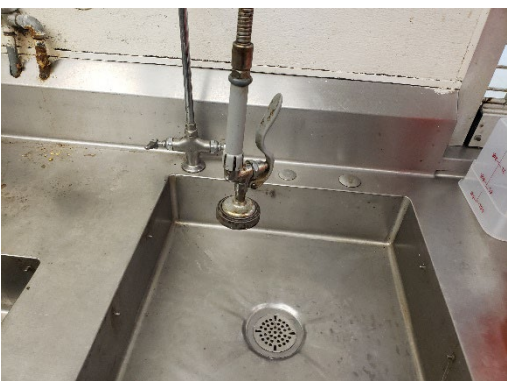
| | | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------|-----------|-----|----|
| ID: | 235-JHS-89 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Krowne | | |
| | | Description: | | | |
| | | Hand Washing Sink, Southeast | | | |
| | | Result: | <1.0 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | | |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------------|------------|-----|----|
| ID: | 235-JHS-90 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Fisher USA | | |
| | | Description: | | | |
| | | Kitchen Dish Sprayer, Dish Washing Area | | | |
| | | Result: | <1.0 | ppb | |
| | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|----------------------------|------------|-----|----|
| ID: | 235-JHS-91 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Fisher USA | | |
| | | Description: | | | |
| | | Dish Washing Station, Left | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------------------|------------|-----|----|
| ID: | 235-JHS-92 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | Fisher USA | | |
| | | Description: | | | |
| | | Dish Washing Station, Right | | | |
| | | Result: | 2.6 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|----------------------------------|-----------|-----|----|
| ID: | 235-JHS-93 | Location: | Kitchen | | |
| Photo: |  | Manufacturer: | T&S Brass | | |
| | | Description: | | | |
| | | Dish Return Kitchen Dish Sprayer | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|--------------------|-----|
| ID: | 235-JHS-94 | Location: | Kitchen | |
| Photo: |  | Manufacturer: | Chicago Faucet Co. | |
| | | Description: | | |
| | | Pot Filler, Left (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------|------------------|-----|
| ID: | 235-JHS-95 | Location: | Kitchen Restroom | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | <1.0 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|------------------------|-----|
| ID: | 235-JHS-96 | Location: | Cafeteria Service Area | |
| Photo: |  | Manufacturer: | BKR | |
| | | Description: | | |
| | | Hand Washing Sink | | |
| | | Result: | 207 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------------------------|---------------------|-----|
| ID: | 235-JHS-97 | Location: | Cafeteria Restrooms | |
| Photo: |  | Manufacturer: | Elkay | |
| | | Description: | | |
| | | Drinking Fountain Bubbler, Left | | |
| | | Result: | <1.0 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------------------|---------------------|-----|
| ID: | 235-JHS-98 | Location: | Cafeteria Restrooms | |
| Photo: |  | Manufacturer: | Elkay | |
| | | Description: | | |
| | | Drinking Fountain Bubbler, Right | | |
| | | Result: | <1.0 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------------|----------------------|-----|
| ID: | 235-JHS-99 | Location: | Cafeteria Women's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Left | | |
| | | Result: | <1.0 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------|----------------------|--------|
| ID: | 235-JHS-100 | Location: | Cafeteria Women's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Center | | |
| | | Result: | 1.5 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------|----------------------|--------|
| ID: | 235-JHS-101 | Location: | Cafeteria Women's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Right | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------------------------|--------------------|--------|
| ID: | 235-JHS-102 | Location: | Cafeteria Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Left | | |
| | | Result: | 7.6 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |
| | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------------------------------------|--------------------|-----|
| ID: | 235-JHS-103 | Location: | Cafeteria Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Center (Low Flow, No Sample) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------------|--------------------|-----|
| ID: | 235-JHS-104 | Location: | Cafeteria Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink Right | | |
| | | Result: | <1.0 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------|-----------------------|-----|
| ID: | 235-JHS-105 | Location: | Cafeteria Concessions | |
| Photo: |  | Manufacturer: | Elkay | |
| | | Description: | | |
| | | Kitchenette Sink | | |
| | | Result: | <1.0 | ppb |
| | | Date Sampled: | 8/10/2023 | By: |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------------------------|------------|-----|
| ID: | 235-JHS-106 | Location: | A Gym Hall | |
| Photo: |  | Manufacturer: | Elkay | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler | | |
| | | Result: | 1.8 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|-------------------------------------------------------------------|---------------------|-----|
| ID: | 235-JHS-107 | Location: | A172 Women's Locker | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Locker Room Drinking Fountain Bubbler (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|---------------------|-----|
| ID: | 235-JHS-108 | Location: | A172 Women's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Right Restroom Sink | | |
| | | Result: | 30.2 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

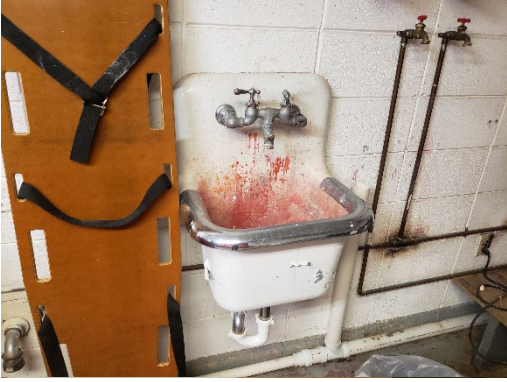
Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------|---------------------|--------|
| ID: | 235-JHS-109 | Location: | A172 Women's Locker | |
| Photo: |  | Manufacturer: | Symmons | |
| | | Description: | | |
| | | Left Restroom Sink | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|------------------------------------------------------------------------------------|------------------------------|--------------------|--------|
| ID: | 235-JHS-110 | Location: | A178 Locker Office | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Office Sink (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------|------------------------|--------|
| ID: | 235-JHS-111 | Location: | A171S Athletic Trainer | |
| Photo: |  | Manufacturer: | Manitowoc | |
| | | Description: | | |
| | | Ice Machine | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|------------------------|------------------------|-----|----|
| ID: | 235-JHS-112 | Location: | A171S Athletic Trainer | | |
| Photo: |  | Manufacturer: | Unknown | | |
| | | Description: | | | |
| | | Trainer Room Deep Sink | | | |
| | | Result: | 3.4 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

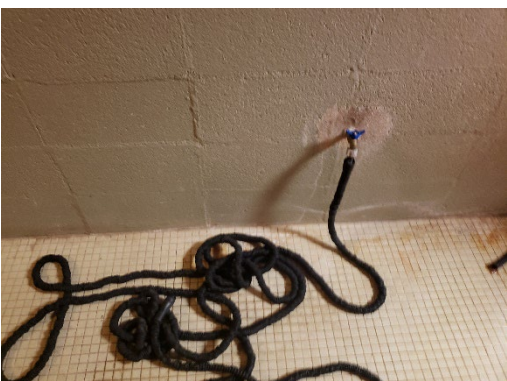
| | | | | | |
|---------------------|------------------------------------------------------------------------------------|-------------------------------------------------------|-------------------|-----|----|
| ID: | 235-JHS-113 | Location: | A169 Men's Locker | | |
| Photo: |  | Manufacturer: | Halsey-Taylor | | |
| | | Description: | | | |
| | | Standalone Drinking Fountain Bubbler (Non-Functional) | | | |
| | | Result: | N/A | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|-------------------|-----|----|
| ID: | 235-JHS-114 | Location: | A169 Men's Locker | | |
| Photo: |  | Manufacturer: | Delta | | |
| | | Description: | | | |
| | | Left Restroom Sink | | | |
| | | Result: | 8 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| | | Replace Fixture/Unit and Resample | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|------------------------------|-------------------|-----|
| ID: | 235-JHS-115 | Location: | A169 Men's Locker | |
| Photo: |  | Manufacturer: | Speakman | |
| | | Description: | | |
| | | Office Sink (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|---------------------|-------------------|-----|
| ID: | 235-JHS-116 | Location: | A169 Men's Locker | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Right Restroom Sink | | |
| | | Result: | 2.1 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------------|-------------------|-----|
| ID: | 235-JHS-117 | Location: | A169 Men's Locker | |
| Photo: |  | Manufacturer: | Everbilt | |
| | | Description: | | |
| | | Locker Room Hose Spigot | | |
| | | Result: | <1.0 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | | |
|---------------------|-----------------------------------------------------------------------------------|--------------------------------------|----------------------|-----|----|
| ID: | 235-JHS-118 | Location: | A Gym Locker Rm Hall | | |
| Photo: |  | Manufacturer: | jHalsey-Taylor | | |
| | | Description: | | | |
| | | Standalone Drinking Fountain Bubbler | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |


| | | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------------|------------------|-----|----|
| ID: | 235-JHS-119 | Location: | Woodshop Storage | | |
| Photo: |  | Manufacturer: | Halsey-Taylor | | |
| | | Description: | | | |
| | | Standalone Drinking Fountain Bubbler | | | |
| | | Result: | <1.0 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |

| | | | | | |
|---------------------|-------------------------------------------------------------------------------------|-----------------------------------|---------------|-----|----|
| ID: | 235-JHS-120 | Location: | A100 Art Room | | |
| Photo: |  | Manufacturer: | T&S Brass | | |
| | | Description: | | | |
| | | Art Room Sink 1 (Leftmost Unit) | | | |
| | | Result: | 8 | ppb | |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: | NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------|---------------|--------|
| ID: | 235-JHS-121 | Location: | A100 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink 2 | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|-----------------|---------------|--------|
| ID: | 235-JHS-122 | Location: | A100 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink 3 | | |
| | | Result: | 1.6 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|------------------------------------------|---------------|--------|
| ID: | 235-JHS-123 | Location: | A100 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink 4 (Rightmost Unit) | | |
| | | Result: | 86.8 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |
| | | Replace Fixture/Unit and Resample | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-------------------|---------------|--------|
| ID: | 235-JHS-124 | Location: | A101 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink "1" | | |
| | | Result: | 1.4 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|-------------------|---------------|--------|
| ID: | 235-JHS-125 | Location: | A101 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink "2" | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------|---------------|--------|
| ID: | 235-JHS-126 | Location: | A101 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink "3" | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-------------------|---------------|--------|
| ID: | 235-JHS-127 | Location: | A101 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink "4" | | |
| | | Result: | 1 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|-------------------|---------------|--------|
| ID: | 235-JHS-128 | Location: | A101 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink "5" | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------|---------------|--------|
| ID: | 235-JHS-129 | Location: | A101 Art Room | |
| Photo: |  | Manufacturer: | T&S Brass | |
| | | Description: | | |
| | | Art Room Sink "6" | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-------------------------------------------------------|-----------|--------|
| ID: | 235-JHS-130 | Location: | A100 Hall | |
| Photo: |  | Manufacturer: | Oasis | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler (Non-Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------------------------|---------------|--------|
| ID: | 235-JHS-131 | Location: | A100 Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Left (Non-Functional) | | |
| | | Result: | N/A | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|----------------------|---------------|--------|
| ID: | 235-JHS-132 | Location: | A100 Men's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Right | | |
| | | Result: | 1.3 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District


| | | | | |
|---------------------|-----------------------------------------------------------------------------------|---------------------|-----------------|-----|
| ID: | 235-JHS-133 | Location: | A100 Women's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Left | | |
| | | Result: | 3.8 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


| | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------|-----------------|-----|
| ID: | 235-JHS-134 | Location: | A100 Women's RR | |
| Photo: |  | Manufacturer: | Sloan | |
| | | Description: | | |
| | | Restroom Sink, Right | | |
| | | Result: | <1.0 | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|-------------------------------------------------------|---------------------|-----|
| ID: | 235-JHS-135 | Location: | A100 Hall South End | |
| Photo: |  | Manufacturer: | Halsey-Taylor | |
| | | Description: | | |
| | | Standalone Drinking Fountain Bubbler (Non-Functional) | | |
| | | Result: | N/A | ppb |
| Date Sampled: | | 8/10/2023 | By: | NJ |
| Recommended Action: | | | | |


Drinking Water Assessment
Jennings Senior High School
Jennings School District

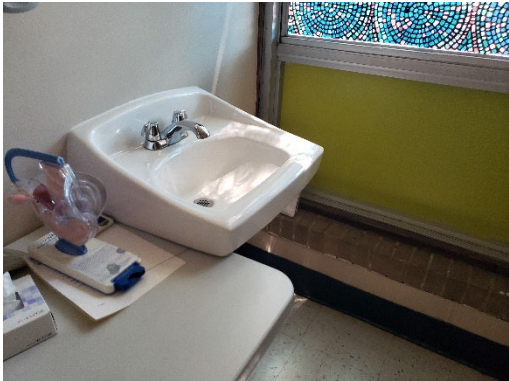
| | | | | |
|---------------------|-----------------------------------------------------------------------------------|----------------------------------|----------------|--------|
| ID: | 235-JHS-136 | Location: | A129B Men's RR | |
| Photo: |  | Manufacturer: | Unknown | |
| | | Description: | | |
| | | Restroom Basin Hand Washing Sink | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|------------------------------------------------------------------------------------|----------------------------------|------------------|--------|
| ID: | 235-JHS-137 | Location: | A129G Women's RR | |
| Photo: |  | Manufacturer: | Unknown | |
| | | Description: | | |
| | | Restroom Basin Hand Washing Sink | | |
| | | Result: | <1.0 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

| | | | | |
|---------------------|-------------------------------------------------------------------------------------|---------------|---------------|--------|
| ID: | 235-JHS-138 | Location: | Clinic Lab RR | |
| Photo: |  | Manufacturer: | Delta | |
| | | Description: | | |
| | | Restroom Sink | | |
| | | Result: | 2 | ppb |
| Recommended Action: | | Date Sampled: | 8/10/2023 | By: NJ |

Drinking Water Assessment
Jennings Senior High School
Jennings School District

| | | | | |
|---------------------|-----------------------------------------------------------------------------------|-----------------------------------|---------------|--------|
| ID: | 235-JHS-139 | Location: | Clinic Room 2 | |
| Photo: |  | Manufacturer: | Delta | |
| | | Description: | | |
| | | Clinic Office Sink | | |
| | | Result: | 17.3 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | Replace Fixture/Unit and Resample | | |

| | | | | |
|---------------------|------------------------------------------------------------------------------------|--------------------|---------------|--------|
| ID: | 235-JHS-140 | Location: | Clinic Room 1 | |
| Photo: |  | Manufacturer: | Delta | |
| | | Description: | | |
| | | Clinic Office Sink | | |
| | | Result: | 2.1 | ppb |
| | | Date Sampled: | 8/10/2023 | By: NJ |
| Recommended Action: | | | | |

ATTACHMENT 2

LABORATORY ANALYTICAL RESULTS AND COC DOCUMENTATION

September 26, 2023

Kevin Heriford
Occu-Tec
2604 NE Industrial Drive
Suite 230
North Kansas, MO 64117
TEL: (816) 231-5580
FAX:



| | |
|-----------|---------|
| Illinois | 100226 |
| Kansas | E-10374 |
| Louisiana | 05002 |
| Louisiana | 05003 |
| Oklahoma | 9978 |

RE: 923235 JHS

WorkOrder: 23080914

Dear Kevin Heriford:

TEKLAB, INC received 115 samples on 8/11/2023 8:08:00 AM for the analysis presented in the following report.

Samples are analyzed on an as received basis unless otherwise requested and documented. The sample results contained in this report relate only to the requested analytes of interest as directed on the chain of custody. NELAP accredited fields of testing are indicated by the letters NELAP under the Certification column. Unless otherwise documented within this report, Teklab Inc. analyzes samples utilizing the most current methods in compliance with 40CFR. All tests are performed in the Collinsville, IL laboratory unless otherwise noted in the Case Narrative.

All quality control criteria applicable to the test methods employed for this project have been satisfactorily met and are in accordance with NELAP except where noted. The following report shall not be reproduced, except in full, without the written approval of Teklab, Inc.

If you have any questions regarding these tests results, please feel free to call.

Sincerely,



Patrick Riley
Project Manager
(618)344-1004 ex 44
patrickriley@teklabinc.com

Client: Occu-Tec

Work Order: 23080914

Client Project: 923235 JHS

Report Date: 26-Sep-23

This reporting package includes the following:

| | |
|----------------------|----------|
| Cover Letter | 1 |
| Report Contents | 2 |
| Definitions | 3 |
| Case Narrative | 5 |
| Accreditations | 6 |
| Laboratory Results | 7 |
| Receiving Check List | 122 |
| Chain of Custody | Appended |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Abbr Definition**

* Analytes on report marked with an asterisk are not NELAP accredited

CCV Continuing calibration verification is a check of a standard to determine the state of calibration of an instrument between recalibration.

CRQL A Client Requested Quantitation Limit is a reporting limit that varies according to customer request. The CRQL may not be less than the MDL.

DF Dilution factor is the dilution performed during analysis only and does not take into account any dilutions made during sample preparation. The reported result is final and includes all dilution factors.

DNI Did not ignite

DUP Laboratory duplicate is a replicate aliquot prepared under the same laboratory conditions and independently analyzed to obtain a measure of precision.

ICV Initial calibration verification is a check of a standard to determine the state of calibration of an instrument before sample analysis is initiated.

IDPH IL Dept. of Public Health

LCS Laboratory control sample is a sample matrix, free from the analytes of interest, spiked with verified known amounts of analytes and analyzed exactly like a sample to establish intra-laboratory or analyst specific precision and bias or to assess the performance of all or a portion of the measurement system.

LCSD Laboratory control sample duplicate is a replicate laboratory control sample that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MBLK Method blank is a sample of a matrix similar to the batch of associated sample (when available) that is free from the analytes of interest and is processed simultaneously with and under the same conditions as samples through all steps of the analytical procedures, and in which no target analytes or interferences should present at concentrations that impact the analytical results for sample analyses.

MDL "The method detection limit is defined as the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results."

MS Matrix spike is an aliquot of matrix fortified (spiked) with known quantities of specific analytes that is subjected to the entire analytical procedures in order to determine the effect of the matrix on an approved test method's recovery system. The acceptable recovery range is listed in the QC Package (provided upon request).

MSD Matrix spike duplicate means a replicate matrix spike that is prepared and analyzed in order to determine the precision of the approved test method. The acceptable recovery range is listed in the QC Package (provided upon request).

MW Molecular weight

NC Data is not acceptable for compliance purposes

ND Not Detected at the Reporting Limit

NELAP NELAP Accredited

PQL Practical quantitation limit means the lowest level that can be reliably achieved within specified limits of precision and accuracy during routine laboratory operation conditions.

RL The reporting limit the lowest level that the data is displayed in the final report. The reporting limit may vary according to customer request or sample dilution. The reporting limit may not be less than the MDL.

RPD Relative percent difference is a calculated difference between two recoveries (ie. MS/MSD). The acceptable recovery limit is listed in the QC Package (provided upon request).

SPK The spike is a known mass of target analyte added to a blank sample or sub-sample; used to determine recovery deficiency or for other quality control purposes.

Surr Surrogates are compounds which are similar to the analytes of interest in chemical composition and behavior in the analytical process, but which are not normally found in environmental samples.

TIC Tentatively identified compound: Analytes tentatively identified in the sample by using a library search. Only results not in the calibration standard will be reported as tentatively identified compounds. Results for tentatively identified compounds that are not present in the calibration standard, but are assigned a specific chemical name based upon the library search, are calculated using total peak areas from reconstructed ion chromatograms and a response factor of one. The nearest Internal Standard is used for the calculation. The results of any TICs must be considered estimated, and are flagged with a "T". If the estimated result is above the calibration range it is flagged "ET"

TNTC Too numerous to count (> 200 CFU)

Client: Occu-Tec

Work Order: 23080914

Client Project: 923235 JHS

Report Date: 26-Sep-23

Qualifiers

- | | |
|-------------------------------------------------------|--------------------------------------------------------------|
| # - Unknown hydrocarbon | B - Analyte detected in associated Method Blank |
| C - RL shown is a Client Requested Quantitation Limit | E - Value above quantitation range |
| H - Holding times exceeded | I - Associated internal standard was outside method criteria |
| J - Analyte detected below quantitation limits | M - Manual Integration used to determine area response |
| ND - Not Detected at the Reporting Limit | R - RPD outside accepted recovery limits |
| S - Spike Recovery outside recovery limits | T - TIC(Tentatively identified compound) |
| X - Value exceeds Maximum Contaminant Level | |



Case Narrative

<http://www.teklabinc.com/>

Client: Occu-Tec

Work Order: 23080914

Client Project: 923235 JHS

Report Date: 26-Sep-23

Cooler Receipt Temp: NA °C

Locations

Collinsville

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email jhriley@teklabinc.com

Collinsville Air

Address 5445 Horseshoe Lake Road
Collinsville, IL 62234-7425
Phone (618) 344-1004
Fax (618) 344-1005
Email EHurley@teklabinc.com

Springfield

Address 3920 Pintail Dr
Springfield, IL 62711-9415
Phone (217) 698-1004
Fax (217) 698-1005
Email KKlostermann@teklabinc.com

Chicago

Address 1319 Butterfield Rd.
Downers Grove, IL 60515
Phone (630) 324-6855
Fax
Email arenner@teklabinc.com

Kansas City

Address 8421 Nieman Road
Lenexa, KS 66214
Phone (913) 541-1998
Fax (913) 541-1998
Email jhriley@teklabinc.com

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23

| State | Dept | Cert # | NELAP | Exp Date | Lab |
|-----------|------|---------|-------|-----------|--------------|
| Illinois | IEPA | 100226 | NELAP | 1/31/2024 | Collinsville |
| Kansas | KDHE | E-10374 | NELAP | 4/30/2024 | Collinsville |
| Louisiana | LDEQ | 05002 | NELAP | 6/30/2024 | Collinsville |
| Louisiana | LDEQ | 05003 | NELAP | 6/30/2024 | Collinsville |
| Oklahoma | ODEQ | 9978 | NELAP | 8/31/2024 | Collinsville |
| Arkansas | ADEQ | 88-0966 | | 3/14/2024 | Collinsville |
| Illinois | IDPH | 17584 | | 5/31/2025 | Collinsville |
| Iowa | IDNR | 430 | | 6/1/2024 | Collinsville |
| Kentucky | UST | 0073 | | 1/31/2024 | Collinsville |
| Missouri | MDNR | 00930 | | 5/31/2023 | Collinsville |
| Missouri | MDNR | 930 | | 1/31/2025 | Collinsville |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-001
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-01
Collection Date: 08/10/2023 7:08

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 6.8 | µg/L | 1 | 09/20/2023 5:00 | 211506 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-002**Client Sample ID:** 235-JHS-04**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:12

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|------|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 10.0 | | 208 | µg/L | 10 | 09/21/2023 14:42 | 211506 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-003
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-05
Collection Date: 08/10/2023 7:15

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 4.0 | | 106 | µg/L | 20 | 09/22/2023 16:34 | 211541 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-004
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-06
Collection Date: 08/10/2023 7:19

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 26.1 | µg/L | 1 | 09/21/2023 14:45 | 211506 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-005**Client Sample ID:** 235-JHS-07**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:24

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 257 | µg/L | 5 | 09/22/2023 16:37 | 211541 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-006
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-10
Collection Date: 08/10/2023 7:29

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 21.6 | µg/L | 5 | 09/22/2023 16:41 | 211541 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-007
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-12
Collection Date: 08/10/2023 7:32

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 41.2 | µg/L | 5 | 09/22/2023 16:52 | 211543 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-008**Client Sample ID:** 235-JHS-13**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:32

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.9 | µg/L | 1 | 09/20/2023 5:18 | 211506 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-009
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-14
Collection Date: 08/10/2023 7:37

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 5.7 | µg/L | 1 | 09/20/2023 5:22 | 211506 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-010**Client Sample ID:** 235-JHS-15**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:40

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 4.0 | | 221 | µg/L | 20 | 09/22/2023 16:56 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-011
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-16
Collection Date: 08/10/2023 7:42

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|------|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 20.0 | | 526 | µg/L | 20 | 09/21/2023 14:56 | 211506 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-012**Client Sample ID:** 235-JHS-17**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:45

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 5:29 | 211506 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-013**Client Sample ID:** 235-JHS-18**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:45

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 5:33 | 211506 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-014**Client Sample ID:** 235-JHS-19**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 7:48

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.1 | µg/L | 1 | 09/20/2023 5:47 | 211506 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-015
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-20
Collection Date: 08/10/2023 7:50

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 32.7 | µg/L | 5 | 09/22/2023 16:59 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-016
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-22
Collection Date: 08/10/2023 7:54

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.3 | µg/L | 5 | 09/22/2023 17:14 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-017
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-23
Collection Date: 08/10/2023 7:54

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.8 | µg/L | 1 | 09/19/2023 17:58 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-018
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-24
Collection Date: 08/10/2023 7:54

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.5 | µg/L | 1 | 09/21/2023 10:14 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-019
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-25
Collection Date: 08/10/2023 7:58

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.8 | µg/L | 5 | 09/22/2023 17:25 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-020
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-26
Collection Date: 08/10/2023 7:58

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.2 | µg/L | 5 | 09/22/2023 17:29 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-021
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-27
Collection Date: 08/10/2023 7:58

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 23.5 | µg/L | 5 | 09/22/2023 17:32 | 211543 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-022**Client Sample ID:** 235-JHS-28**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:02

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|-------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 73.8 | µg/L | 5 | 09/22/2023 17:36 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-023
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-29
Collection Date: 08/10/2023 8:04

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 18:02 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-024
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-32
Collection Date: 08/10/2023 8:08

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.2 | µg/L | 1 | 09/19/2023 18:05 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-025
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-33
Collection Date: 08/10/2023 8:08

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.5 | µg/L | 1 | 09/19/2023 18:09 | 211507 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-026**Client Sample ID:** 235-JHS-34**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:11

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.1 | µg/L | 1 | 09/21/2023 10:36 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-027
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-35
Collection Date: 08/10/2023 8:11

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.2 | µg/L | 1 | 09/19/2023 18:13 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-028
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-36
Collection Date: 08/10/2023 8:16

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 13.8 | µg/L | 1 | 09/19/2023 18:52 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-029
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-37
Collection Date: 08/10/2023 8:19

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.3 | µg/L | 1 | 09/19/2023 18:56 | 211507 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-030**Client Sample ID:** 235-JHS-38**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:23

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 6.4 | µg/L | 1 | 09/19/2023 18:59 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-031
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-39
Collection Date: 08/10/2023 8:24

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 5.5 | µg/L | 1 | 09/19/2023 19:03 | 211507 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-032**Client Sample ID:** 235-JHS-40**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:25

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.6 | µg/L | 1 | 09/19/2023 19:06 | 211507 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-033**Client Sample ID:** 235-JHS-42**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:28

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.4 | µg/L | 1 | 09/19/2023 19:10 | 211507 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-034**Client Sample ID:** 235-JHS-43**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:31

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 77.6 | µg/L | 1 | 09/19/2023 19:14 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-035
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-45
Collection Date: 08/10/2023 8:35

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.9 | µg/L | 1 | 09/19/2023 19:17 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-036
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-46
Collection Date: 08/10/2023 8:36

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.9 | µg/L | 1 | 09/19/2023 19:21 | 211507 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-037
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-47
Collection Date: 08/10/2023 8:36

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 13.3 | µg/L | 5 | 09/22/2023 17:40 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-038
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-48
Collection Date: 08/10/2023 8:38

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.8 | µg/L | 1 | 09/19/2023 21:52 | 211508 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-039
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-49
Collection Date: 08/10/2023 8:40

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:55 | 211508 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-040
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-51
Collection Date: 08/10/2023 8:50

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.8 | µg/L | 1 | 09/19/2023 21:59 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-041**Client Sample ID:** 235-JHS-53**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 8:48

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 5.3 | µg/L | 1 | 09/19/2023 22:10 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-042**Client Sample ID:** 235-JHS-54**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:01

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.8 | µg/L | 5 | 09/22/2023 17:43 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-043
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-55
Collection Date: 08/10/2023 9:05

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 22:14 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-044**Client Sample ID:** 235-JHS-56**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:06

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 22:17 | 211508 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-045
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-57
Collection Date: 08/10/2023 9:09

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.4 | µg/L | 1 | 09/19/2023 22:21 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-046**Client Sample ID:** 235-JHS-58**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:11

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 22:39 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-047**Client Sample ID:** 235-JHS-60**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:13

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.0 | µg/L | 1 | 09/19/2023 22:50 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-048**Client Sample ID:** 235-JHS-61**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:14

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 8.7 | µg/L | 5 | 09/22/2023 17:47 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-049
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-63
Collection Date: 08/10/2023 9:18

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 22:54 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-050**Client Sample ID:** 235-JHS-64**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:24

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.2 | µg/L | 1 | 09/19/2023 22:58 | 211508 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-051
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-65
Collection Date: 08/10/2023 9:24

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.8 | µg/L | 1 | 09/19/2023 23:01 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-052**Client Sample ID:** 235-JHS-66**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:28

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 23:05 | 211508 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-053
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-67
Collection Date: 08/10/2023 9:30

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 23:09 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-054**Client Sample ID:** 235-JHS-69**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:35

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.2 | µg/L | 1 | 09/19/2023 23:12 | 211508 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-055
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-70
Collection Date: 08/10/2023 9:36

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.2 | µg/L | 1 | 09/19/2023 23:27 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-056**Client Sample ID:** 235-JHS-71**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:36

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.6 | µg/L | 1 | 09/19/2023 23:31 | 211508 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-057**Client Sample ID:** 235-JHS-72**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:37

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.2 | µg/L | 1 | 09/19/2023 20:31 | 211511 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-058**Client Sample ID:** 235-JHS-73**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:39

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.7 | µg/L | 5 | 09/22/2023 18:02 | 211543 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-059**Client Sample ID:** 235-JHS-74**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:40

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.0 | µg/L | 5 | 09/22/2023 18:05 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-060
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-75
Collection Date: 08/10/2023 9:41

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.6 | µg/L | 1 | 09/19/2023 20:35 | 211511 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-061
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-77
Collection Date: 08/10/2023 9:44

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.3 | µg/L | 1 | 09/19/2023 20:39 | 211511 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-062**Client Sample ID:** 235-JHS-78**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:46

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.3 | µg/L | 1 | 09/19/2023 21:01 | 211511 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-063**Client Sample ID:** 235-JHS-79**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 9:48

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:04 | 211511 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-064**Client Sample ID:** 235-JHS-80**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:15

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:08 | 211511 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-065**Client Sample ID:** 235-JHS-81**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:44

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:12 | 211511 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-066**Client Sample ID:** 235-JHS-82**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:18

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|-------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 16.2 | µg/L | 5 | 09/22/2023 18:09 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-067
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-83
Collection Date: 08/10/2023 10:19

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 23.1 | µg/L | 5 | 09/22/2023 18:13 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-068
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-84
Collection Date: 08/10/2023 10:20

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 8.2 | µg/L | 5 | 09/22/2023 18:24 | 211543 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-069**Client Sample ID:** 235-JHS-85**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:21

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 4.9 | µg/L | 5 | 09/22/2023 18:27 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-070
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-86
Collection Date: 08/10/2023 10:23

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.7 | µg/L | 1 | 09/19/2023 21:15 | 211511 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-071
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-87
Collection Date: 08/10/2023 10:25

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 48.0 | µg/L | 5 | 09/22/2023 18:31 | 211543 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-072**Client Sample ID:** 235-JHS-89**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:26

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:26 | 211511 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-073
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-90
Collection Date: 08/10/2023 10:28

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:30 | 211511 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-074
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-91
Collection Date: 08/10/2023 10:34

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/19/2023 21:34 | 211511 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-075
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-92
Collection Date: 08/10/2023 10:35

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.6 | µg/L | 1 | 09/19/2023 21:48 | 211511 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-076
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-93
Collection Date: 08/10/2023 10:29

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 5 | 09/22/2023 18:35 | 211543 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-077
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-95
Collection Date: 08/10/2023 10:40

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:52 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-078
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-96
Collection Date: 08/10/2023 10:46

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 207 | µg/L | 5 | 09/22/2023 18:49 | 211543 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-079**Client Sample ID:** 235-JHS-97**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:53

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:55 | 211512 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-080
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-98
Collection Date: 08/10/2023 10:54

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:59 | 211512 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-081**Client Sample ID:** 235-JHS-99**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:56

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 3:03 | 211512 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-082
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-100
Collection Date: 08/10/2023 10:58

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.5 | µg/L | 1 | 09/20/2023 3:25 | 211512 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-083**Client Sample ID:** 235-JHS-101**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 10:59

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 3:28 | 211512 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-084**Client Sample ID:** 235-JHS-102**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 11:03

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 7.6 | µg/L | 1 | 09/20/2023 3:32 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-085
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-104
Collection Date: 08/10/2023 11:04

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 3:36 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-086
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-105
Collection Date: 08/10/2023 11:06

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 3:39 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-087
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-106
Collection Date: 08/10/2023 11:10

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.8 | µg/L | 1 | 09/20/2023 3:43 | 211512 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-088
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-108
Collection Date: 08/10/2023 11:17

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|-------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 30.2 | µg/L | 5 | 09/22/2023 14:33 | 211550 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-089**Client Sample ID:** 235-JHS-109**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 11:19

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 3:54 | 211512 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-090**Client Sample ID:** 235-JHS-111A**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 11:22

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 5 | 09/22/2023 14:36 | 211550 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-091
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-112
Collection Date: 08/10/2023 11:24

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.4 | µg/L | 1 | 09/20/2023 3:58 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-092
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-114
Collection Date: 08/10/2023 11:27

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 8.0 | µg/L | 1 | 09/20/2023 4:12 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-093
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-116
Collection Date: 08/10/2023 11:30

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.1 | µg/L | 1 | 09/20/2023 4:16 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-094
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-117
Collection Date: 08/10/2023 11:34

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 4:20 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-095
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-118
Collection Date: 08/10/2023 11:35

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 4:23 | 211512 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-096
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-119
Collection Date: 08/10/2023 11:39

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 4:27 | 211512 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-097
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-120
Collection Date: 08/10/2023 11:43

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|------------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 8.0 | µg/L | 1 | 09/20/2023 1:20 | 211513 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-098
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-121
Collection Date: 08/10/2023 11:44

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 1:24 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-099
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-122
Collection Date: 08/10/2023 11:45

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.6 | µg/L | 1 | 09/20/2023 1:28 | 211513 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-100**Client Sample ID:** 235-JHS-123**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 11:46

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|-------------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 86.8 | µg/L | 5 | 09/22/2023 14:51 | 211550 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-101**Client Sample ID:** 235-JHS-124**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 11:48

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.4 | µg/L | 1 | 09/20/2023 1:31 | 211513 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-102
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-125
Collection Date: 08/10/2023 11:49

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 1:35 | 211513 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-103**Client Sample ID:** 235-JHS-126**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 11:51

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 1:50 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-104
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-127
Collection Date: 08/10/2023 11:52

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.0 | µg/L | 1 | 09/20/2023 2:00 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-105
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-128
Collection Date: 08/10/2023 11:53

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:04 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-106
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-129
Collection Date: 08/10/2023 11:54

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:08 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-107
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-132
Collection Date: 08/10/2023 11:59

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 1.3 | µg/L | 1 | 09/20/2023 2:11 | 211513 |

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-108
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-133
Collection Date: 08/10/2023 12:01

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 3.8 | µg/L | 1 | 09/20/2023 2:22 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-109
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-134
Collection Date: 08/10/2023 12:02

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:37 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-110
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-136
Collection Date: 08/10/2023 12:28

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:41 | 211513 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-111**Client Sample ID:** 235-JHS-137**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 12:30

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 1 | 09/20/2023 2:44 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-112
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-138
Collection Date: 08/10/2023 12:36

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.0 | µg/L | 5 | 09/21/2023 20:52 | 211550 |

Client: Occu-Tec**Work Order:** 23080914**Client Project:** 923235 JHS**Report Date:** 26-Sep-23**Lab ID:** 23080914-113**Client Sample ID:** 235-JHS-139**Matrix:** DRINKING WATER**Collection Date:** 08/10/2023 12:37

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|-----------------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 17.3 | µg/L | 5 | 09/21/2023 20:56 | 211550 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-114
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-140
Collection Date: 08/10/2023 12:38

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|-----------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | 2.1 | µg/L | 1 | 09/20/2023 2:48 | 211513 |



Laboratory Results

<http://www.teklabinc.com/>

Client: Occu-Tec
Client Project: 923235 JHS
Lab ID: 23080914-115
Matrix: DRINKING WATER

Work Order: 23080914
Report Date: 26-Sep-23
Client Sample ID: 235-JHS-111B
Collection Date: 08/10/2023 0:00

| Analyses | Certification | RL | Qual | Result | Units | DF | Date Analyzed | Batch |
|----------------------------------------------------|---------------|-----|------|--------|-------|----|------------------|--------|
| EPA 600 4.1.4, 200.8 R5.4, METALS BY ICPMS (TOTAL) | | | | | | | | |
| Lead | NELAP | 1.0 | | < 1.0 | µg/L | 5 | 09/21/2023 20:59 | 211550 |



Receiving Check List

<http://www.teklabinc.com/>

Client: Occu-Tec

Work Order: 23080914

Client Project: 923235 JHS

Report Date: 26-Sep-23

Carrier: Crossroads

Received By: ANC

Completed by:

On:

11-Aug-23

Allison Colin

Reviewed by:

On:

14-Aug-23

Elizabeth A. Hurley

Pages to follow: Chain of custody

Extra pages included

| | | | | |
|---------------------------------------------------------|------------------------------------------|------------------------------|----------------------------------------|----------------------------------|
| Shipping container/cooler in good condition? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | Not Present <input type="checkbox"/> | Temp °C NA |
| Type of thermal preservation? | None <input checked="" type="checkbox"/> | Ice <input type="checkbox"/> | Blue Ice <input type="checkbox"/> | Dry Ice <input type="checkbox"/> |
| Chain of custody present? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| Chain of custody signed when relinquished and received? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| Chain of custody agrees with sample labels? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| Samples in proper container/bottle? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| Sample containers intact? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| Sufficient sample volume for indicated test? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| All samples received within holding time? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |
| Reported field parameters measured: | Field <input type="checkbox"/> | Lab <input type="checkbox"/> | NA <input checked="" type="checkbox"/> | |
| Container/Temp Blank temperature in compliance? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | | |

When thermal preservation is required, samples are compliant with a temperature between 0.1°C - 6.0°C, or when samples are received on ice the same day as collected.

| | | | |
|-----------------------------------------------------------|-----------------------------------------|-----------------------------|-------------------------------------------------------|
| Water – at least one vial per sample has zero headspace? | Yes <input type="checkbox"/> | No <input type="checkbox"/> | No VOA vials <input checked="" type="checkbox"/> |
| Water - TOX containers have zero headspace? | Yes <input type="checkbox"/> | No <input type="checkbox"/> | No TOX containers <input checked="" type="checkbox"/> |
| Water - pH acceptable upon receipt? | Yes <input checked="" type="checkbox"/> | No <input type="checkbox"/> | NA <input type="checkbox"/> |
| NPDES/CWA TCN interferences checked/treated in the field? | Yes <input type="checkbox"/> | No <input type="checkbox"/> | NA <input checked="" type="checkbox"/> |

Any No responses must be detailed below or on the COC.

Samples were checked for turbidity and then preserved with nitric acid upon arrival at the laboratory.

235-JHS-111 was received as -111A and -111B. Samples were logged in as two separate samples. AMD 8/11/23

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement. I hereby certify that I have the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 5 of 5 Workorder # 23080914

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

| | | | | | | | |
|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------|---------------------------------------|----------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-----------------------------|--|
| Client: OCCU-TEC Address: 2604 NE Industrial Drive, #230 City/State/Zip: North Kansas City Contact: Kevin Heriford Phone: 816-825-0628 Email: kheriford@occutech.com Fax: | | | | Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE _____ °C Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>FOR LAB USE ONLY</u> LAB NOTES: | | | |
| Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are there any required reporting limits to be met on the requested analysis? If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | | | | Client Comments: 5 ppb | | | |
| PROJECT NAME/NUMBER 923235 | | SAMPLE COLLECTOR'S NAME Nate Jones | | # and Type of Containers | | INDICATE ANALYSIS REQUESTED | |
| RESULTS REQUESTED <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge) | | BILLING INSTRUCTIONS | | UNP HNO3 NaOH H2SO4 HCL MeOH NaHSO4 TSP Other Pb | | | |
| Lab Use Only | Sample ID | Date/Time Sampled | Matrix | | | | |
| 23080914 -045 | 235-JHS -57 | 8/10/23 909 | Drinking Water | | | | |
| 046 | 235-JHS -58 | 8/10/23 911 | Drinking Water | | | | |
| 047 | 235-JHS -60 | 8/10/23 913 | Drinking Water | | | | |
| 048 | 235-JHS -61 | 8/10/23 914 | Drinking Water | | | | |
| 049 | 235-JHS -63 | 8/10/23 918 | Drinking Water | | | | |
| 050 | 235-JHS -64 | 8/10/23 924 | Drinking Water | | | | |
| 051 | 235-JHS -65 | 8/10/23 924 | Drinking Water | | | | |
| 052 | 235-JHS -66 | 8/10/23 928 | Drinking Water | | | | |
| 053 | 235-JHS -67 | 8/10/23 930 | Drinking Water | | | | |
| 054 | 235-JHS -69 | 8/10/23 935 | Drinking Water | | | | |
| 055 | 235-JHS -70 | 8/10/23 936 | Drinking Water | | | | |
| Relinquished By JS | | Date/Time | | Received By [Signature] | | Date/Time 8/11 808 | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

Client: OCU-TEC
Address: 2604 NE Industrial Drive, #230
City/State/Zip: North Kansas City
Contact: Kevin Heriford Phone: 816-825-0628
Email: kheriford@occutec.com Fax: _____

Samples on: ☐ ICE ☐ BLUE ICE ☐ NO ICE _____ °C
Preserved in: ☐ LAB ☐ FIELD FOR LAB USE ONLY

LAB NOTES:

Client Comments:
5 ppb

Are these samples known to be involved in litigation? If yes, a surcharge will apply: ☐ Yes ☒ No

Are these samples known to be hazardous? ☐ Yes ☒ No

Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: ☒ Yes ☐ No

| | |
|---------------------|--------|
| PROJECT NAME/NUMBER | 923235 |
|---------------------|--------|

SAMPLE COLLECTOR'S NAME

Nate Jones

RESULTS REQUESTED

BILLING INSTRUCTIONS

☒ Standard
 ☐ 1-2 Day (100% Surcharge)
 ☐ Other
 ☐ 3 Day (50% Surcharge)

and Type of Containers

INDICATE ANALYSIS REQUESTED

[illegible]

| Relinquished By | Date/Time | Received By | Date/Time |
|-----------------|-----------|-------------|-----------|
| JS | | A. Coler | 8/11 808 |
| | | | |
| | | | |
| | | | |
| | | | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

CHAIN OF CUSTODY

Pg 7 of 7 Workorder # 28080914

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

| | | | | | | | |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------|---------------------------------------|----------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-----------------------------|--|
| Client: OCCU-TEC Address: 2604 NE Industrial Drive, #230 City/State/Zip: North Kansas City Contact: Kevin Heriford Phone: 816-825-0628 Email: kheriford@occutech.com Fax: | | | | Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE _____ °C Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>FOR LAB USE ONLY</u> LAB NOTES: | | | |
| Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | | | | Client Comments: 5 ppb | | | |
| PROJECT NAME/NUMBER 923235 | | SAMPLE COLLECTOR'S NAME Nate Jones | | # and Type of Containers | | INDICATE ANALYSIS REQUESTED | |
| RESULTS REQUESTED <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge) | | BILLING INSTRUCTIONS | | UNP HNO3 NaOH H2SO4 HCL MeOH NaHSO4 TSP Other Pb | | | |
| Lab Use Only | Sample ID | Date/Time Sampled | Matrix | | | | |
| 23080914 007 | 235-JHS -83 | 8/10/23 1019 | Drinking Water | | | | |
| 008 | 235-JHS -84 | 8/10/23 1020 | Drinking Water | | | | |
| 009 | 235-JHS -85 | 8/10/23 1021 | Drinking Water | | | | |
| 070 | 235-JHS -86 | 8/10/23 1023 | Drinking Water | | | | |
| 071 | 235-JHS -87 | 8/10/23 1025 | Drinking Water | | | | |
| 072 | 235-JHS -89 | 8/10/23 1026 | Drinking Water | | | | |
| 073 | 235-JHS -90 | 8/10/23 1028 | Drinking Water | | | | |
| 074 | 235-JHS -91 | 8/10/23 1034 | Drinking Water | | | | |
| 078 | 235-JHS -92 | 8/10/23 1035 | Drinking Water | | | | |
| 076 | 235-JHS -93 | 8/10/23 1029 | Drinking Water | | | | |
| | 235-JHS 94 | 8/10/23 1037 | Drinking Water | | | | |
| Relinquished By | | Date/Time | | Received By | | Date/Time | |
| 95 | | | | A. Cohen | | 8/11 808 | |
| | | | | | | | |
| | | | | | | | |
| | | | | | | | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

| Client: OCCU-TEC Address: 2604 NE Industrial Drive, #230 City/State/Zip: North Kansas City Contact: Kevin Heriford Phone: 816-825-0628 Email: kheriford@occutech.com Fax: | | | | Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE _____ °C Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>FOR LAB USE ONLY</u> LAB NOTES: Client Comments: 5 ppb | | | | | | | | | | | | | | | | |
|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--------------|-------------------|--------------------------------|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|--|--|--|--|--|------------------------------------|--|--|--|--|--|--|--|
| Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | | | | | | | | | | | | | | | | | | | | |
| PROJECT NAME/NUMBER | | | SAMPLE COLLECTOR'S NAME | | | # and Type of Containers | | | | | | | INDICATE ANALYSIS REQUESTED | | | | | | | |
| 923235 | | | Nate Jones | | | <input type="checkbox"/> UNP <input type="checkbox"/> HNO3 <input type="checkbox"/> NaOH <input type="checkbox"/> H2SO4 <input type="checkbox"/> HCL <input type="checkbox"/> MeOH <input type="checkbox"/> NaHSO4 <input type="checkbox"/> TSP <input type="checkbox"/> Other <input type="checkbox"/> Pb | | | | | | | | | | | | | | |
| RESULTS REQUESTED <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) <input type="checkbox"/> Other _____ <input type="checkbox"/> 3 Day (50% Surcharge) | | | | BILLING INSTRUCTIONS | | | | | | | | | | | | | | | | |
| Lab Use Only | Sample ID | Date/Time Sampled | Matrix | | | | | | | | | | | | | | | | | |
| 23080914 -088 | 235-JHS -108 | 8/10/23 1117 | Drinking Water | | | | | | | | | | | | | | | | | |
| 089 | 235-JHS -109 | 8/10/23 1119 | Drinking Water | | | | | | | | | | | | | | | | | |
| 090 | 235-JHS -111 | 8/10/23 1122 | Drinking Water | | | | | | | | | | | | | | | | | |
| 091 | 235-JHS -112 | 8/10/23 1124 | Drinking Water | | | | | | | | | | | | | | | | | |
| 092 | 235-JHS -114 | 8/10/23 1127 | Drinking Water | | | | | | | | | | | | | | | | | |
| 093 | 235-JHS -116 | 8/10/23 1130 | Drinking Water | | | | | | | | | | | | | | | | | |
| 094 | 235-JHS -117 | 8/10/23 1134 | Drinking Water | | | | | | | | | | | | | | | | | |
| 095 | 235-JHS -118 | 8/10/23 1135 | Drinking Water | | | | | | | | | | | | | | | | | |
| 096 | 235-JHS -119 | 8/10/23 1139 | Drinking Water | | | | | | | | | | | | | | | | | |
| 097 | 235-JHS -120 | 8/10/23 1143 | Drinking Water | | | | | | | | | | | | | | | | | |
| 098 | 235-JHS -121 | 8/10/23 1144 | Drinking Water | | | | | | | | | | | | | | | | | |
| Relinquished By | | | Date/Time | | | Received By | | | | | | | Date/Time | | | | | | | |
| | | | | | | A. Coler | | | | | | | 8/11 508 | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

| | | | | | | | | | | | | | | | | | | | | | | | |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|-------------------------------------------------------------------------------|--|---------------------------------------------------------------------------------------------------------------------|--|----------------|--|--|--|--|--|-----------------------------|--|--|--|--|--|--|--|--|--|--|--|
| Client: OCCU-TEC | | | | Samples on: <input type="checkbox"/> ICE <input type="checkbox"/> BLUE ICE <input type="checkbox"/> NO ICE _____ °C | | | | | | | | | | | | | | | | | | | |
| Address: 2604 NE Industrial Drive, #230 | | | | Preserved in: <input type="checkbox"/> LAB <input type="checkbox"/> FIELD <u>FOR LAB USE ONLY</u> | | | | | | | | | | | | | | | | | | | |
| City/State/Zip: North Kansas City | | | | LAB NOTES: | | | | | | | | | | | | | | | | | | | |
| Contact: Kevin Heriford Phone: 816-825-0628 | | | | Client Comments: | | | | | | | | | | | | | | | | | | | |
| Email: kheriford@occutec.com Fax: | | | | 5 ppb | | | | | | | | | | | | | | | | | | | |
| Are these samples known to be involved in litigation? If yes, a surcharge will apply: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No | | | | | | | | | | | | | | | | | | | | | | | |
| Are these samples known to be hazardous? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No | | | | | | | | | | | | | | | | | | | | | | | |
| Are there any required reporting limits to be met on the requested analysis?. If yes, please provide limits in the comment section: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | | | | | | | | | | | | | | | | | | | | | | | |
| PROJECT NAME/NUMBER | | SAMPLE COLLECTOR'S NAME | | # and Type of Containers | | | | | | | | INDICATE ANALYSIS REQUESTED | | | | | | | | | | | |
| 923235 | | Nate Jones | | | | | | | | | | | | | | | | | | | | | |
| RESULTS REQUESTED | | BILLING INSTRUCTIONS | | | | | | | | | | | | | | | | | | | | | |
| <input checked="" type="checkbox"/> Standard <input type="checkbox"/> 1-2 Day (100% Surcharge) | | <input type="checkbox"/> Other <input type="checkbox"/> 3 Day (50% Surcharge) | | | | | | | | | | | | | | | | | | | | | |
| Lab Use Only | | Sample ID | | Date/Time Sampled | | Matrix | | | | | | | | | | | | | | | | | |
| 23080914 099 | | 235-JHS -122 | | 8/10/23 1145 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 100 | | 235-JHS -123 | | 8/10/23 1146 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 101 | | 235-JHS -124 | | 8/10/23 1148 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 102 | | 235-JHS -125 | | 8/10/23 1149 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 103 | | 235-JHS -126 | | 8/10/23 1151 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 104 | | 235-JHS -127 | | 8/10/23 1152 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 105 | | 235-JHS -128 | | 8/10/23 1153 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 106 | | 235-JHS -129 | | 8/10/23 1154 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 107 | | 235-JHS -132 | | 8/10/23 1159 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 108 | | 235-JHS -133 | | 8/10/23 1201 | | Drinking Water | | | | | | | | | | | | | | | | | |
| 109 | | 235-JHS -134 | | 8/10/23 1202 | | Drinking Water | | | | | | | | | | | | | | | | | |
| Relinquished By | | Date/Time | | Received By | | | | | | | | Date/Time | | | | | | | | | | | |
| KS | | | | A. Collier | | | | | | | | 8/11/2008 | | | | | | | | | | | |

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions

TEKLAB INC, 5445 Horseshoe Lake Road, Collinsville, IL 62234 Phone (618) 344-1004 Fax (618) 344-1005

[illegible]

*The individual signing this agreement on behalf of the client, acknowledges that he/she has read and understands the terms and conditions of this agreement, and that he/she has the authority to sign on behalf of the client. See www.teklabinc.com for terms and conditions